


## Zero Generation Flexibility 2021-2022 Usage 12/17/2021 – 2/14/2022

	LWG	LGS	LMN	IHR	Total Hours Used	Available Hours
Total Hours Used	27	82	77	71	257	3492
Available Hours	873	873	873	873		3492

	LWG	LGS	LMN	IHR	Average
% of Available Hours Used	3.0%	9.2%	8.7%	8.0%	7.2%
% of Total Hours Used	1.9%	5.7%	5.3%	4.9%	4.5%
% of Available Days Used	6.7%	30.0%	26.7%	25.0%	22.1%


# Zero Generation Flexibility 2021-2022 Usage 12/17/2021 – 2/14/2022

## Lower Granite Dam Zero Generation Operations

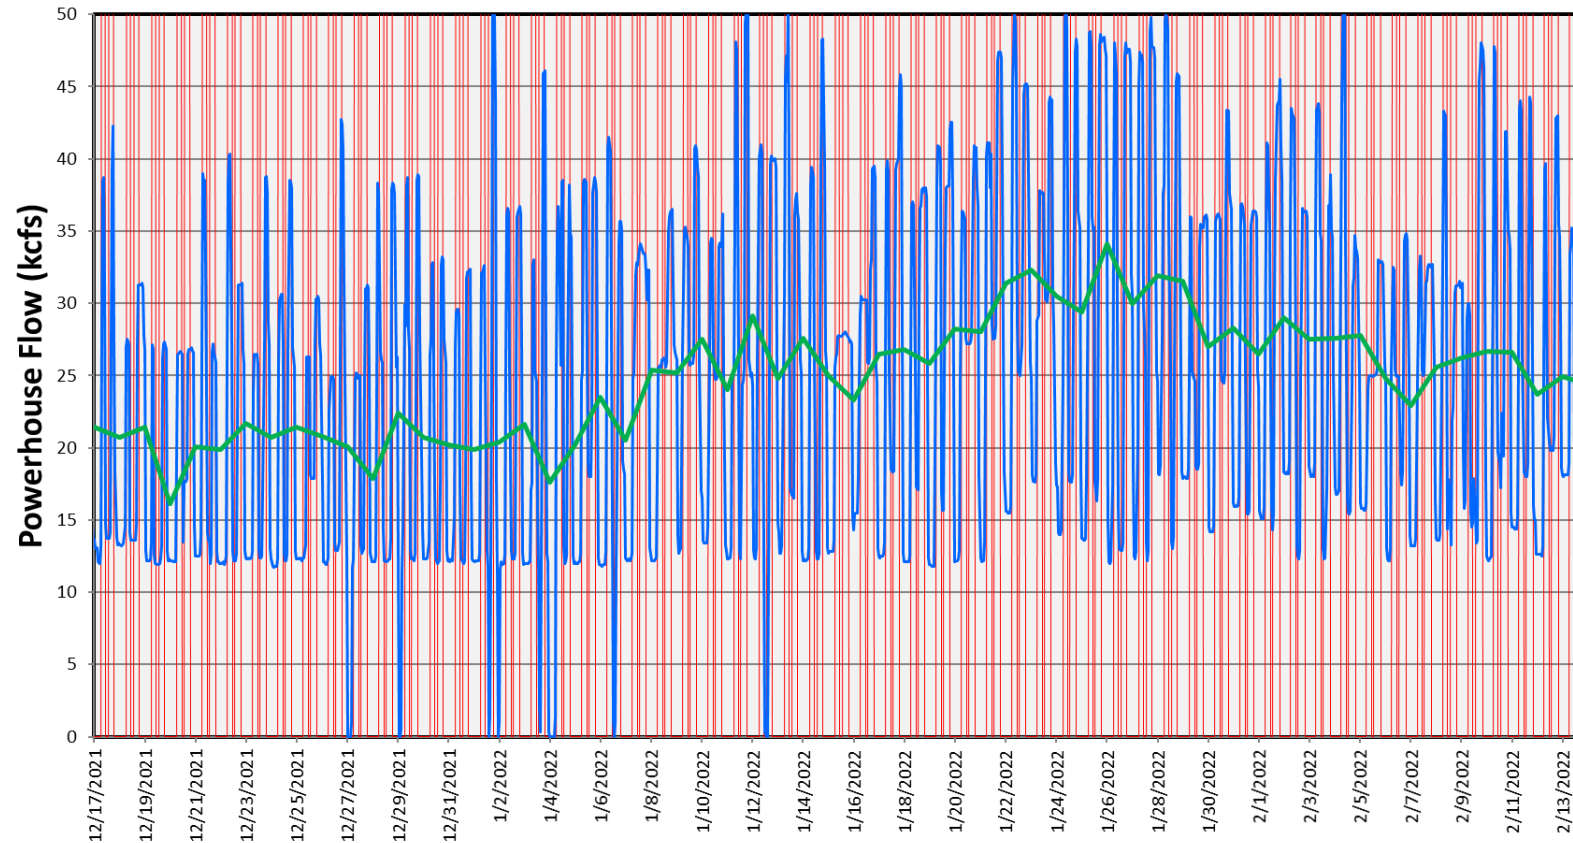


— Zero Gen Hours — LWG Powerhouse Flow — LWG Day Average Flow — Start date — Zero Gen Dates

# Zero Generation Flexibility 2021-2022 Usage 12/17/2021 – 2/14/2022

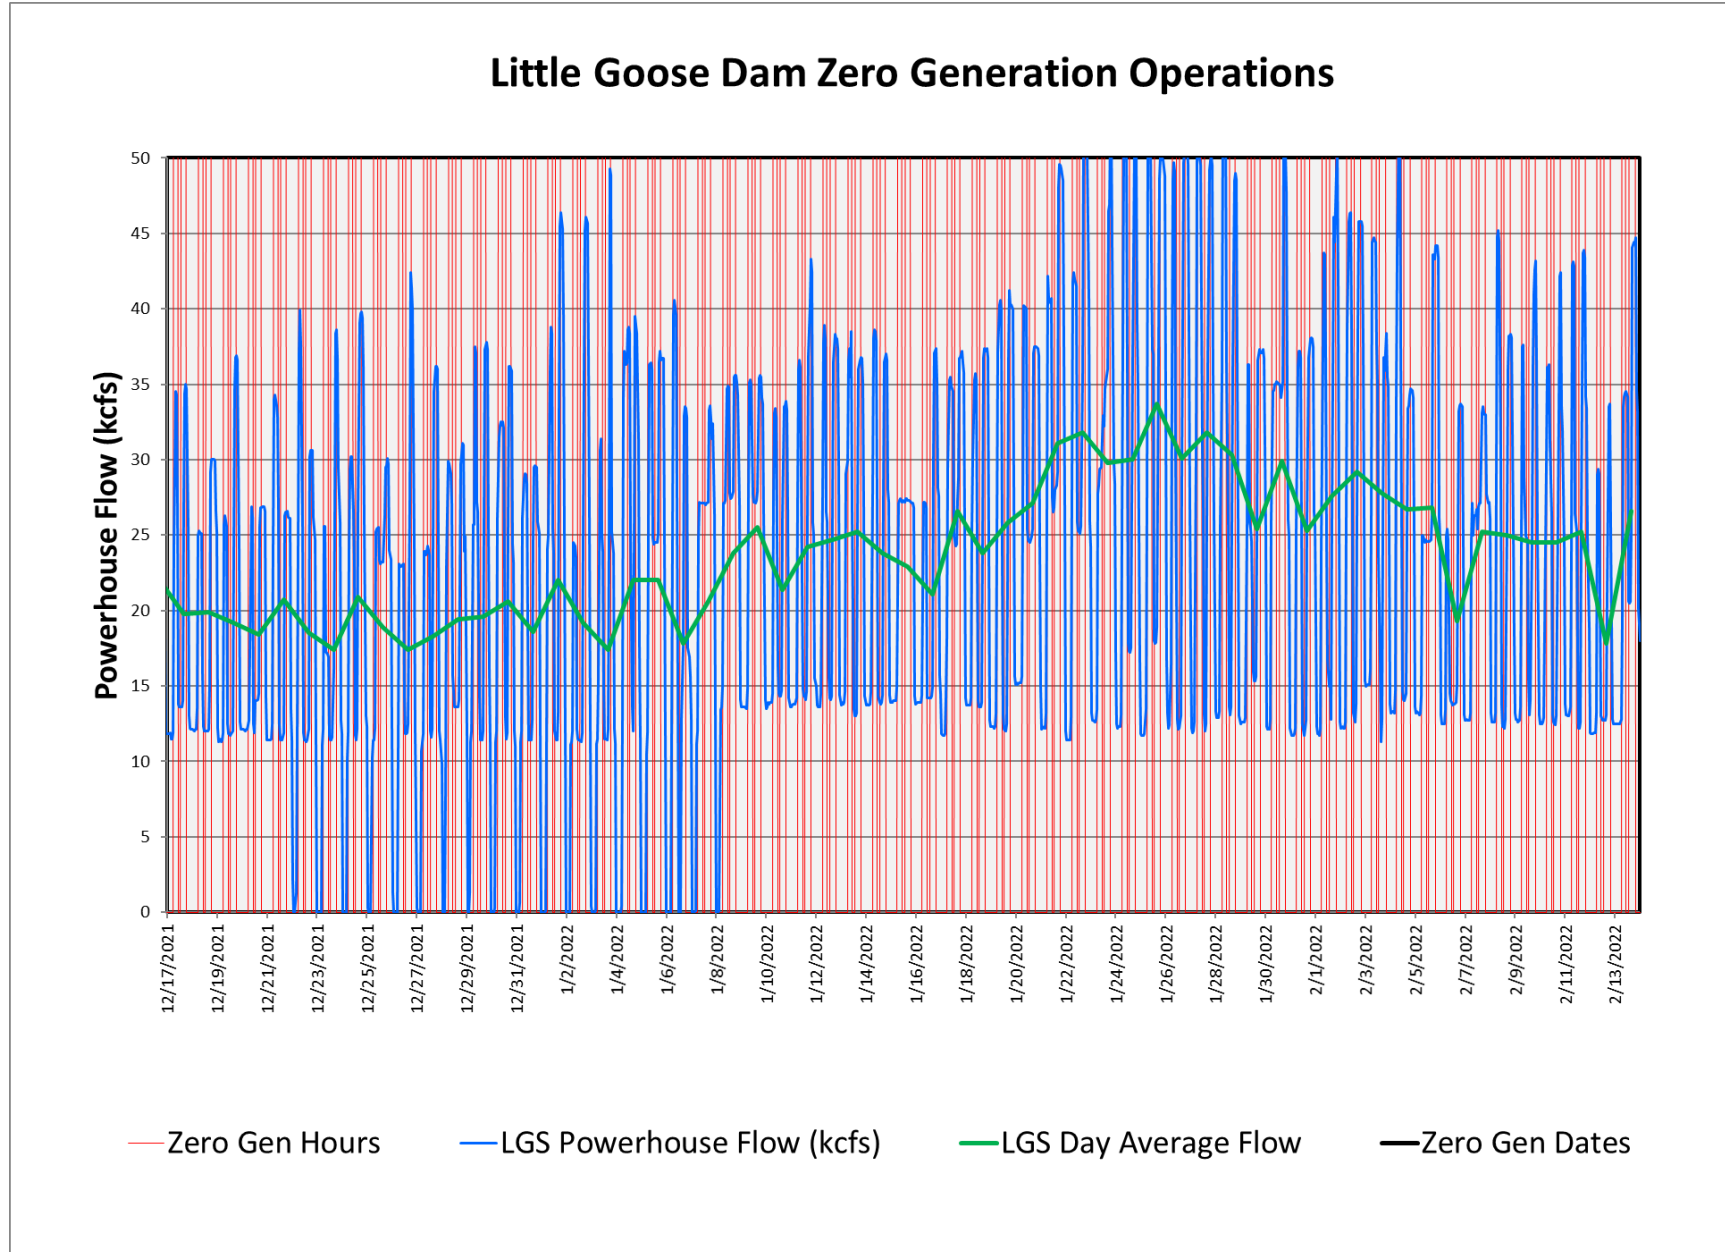


# Zero Generation Flexibility 2021-2022 Usage 12/17/2021 – 2/14/2022


## Lower Monumental Dam Zero Generation Operations

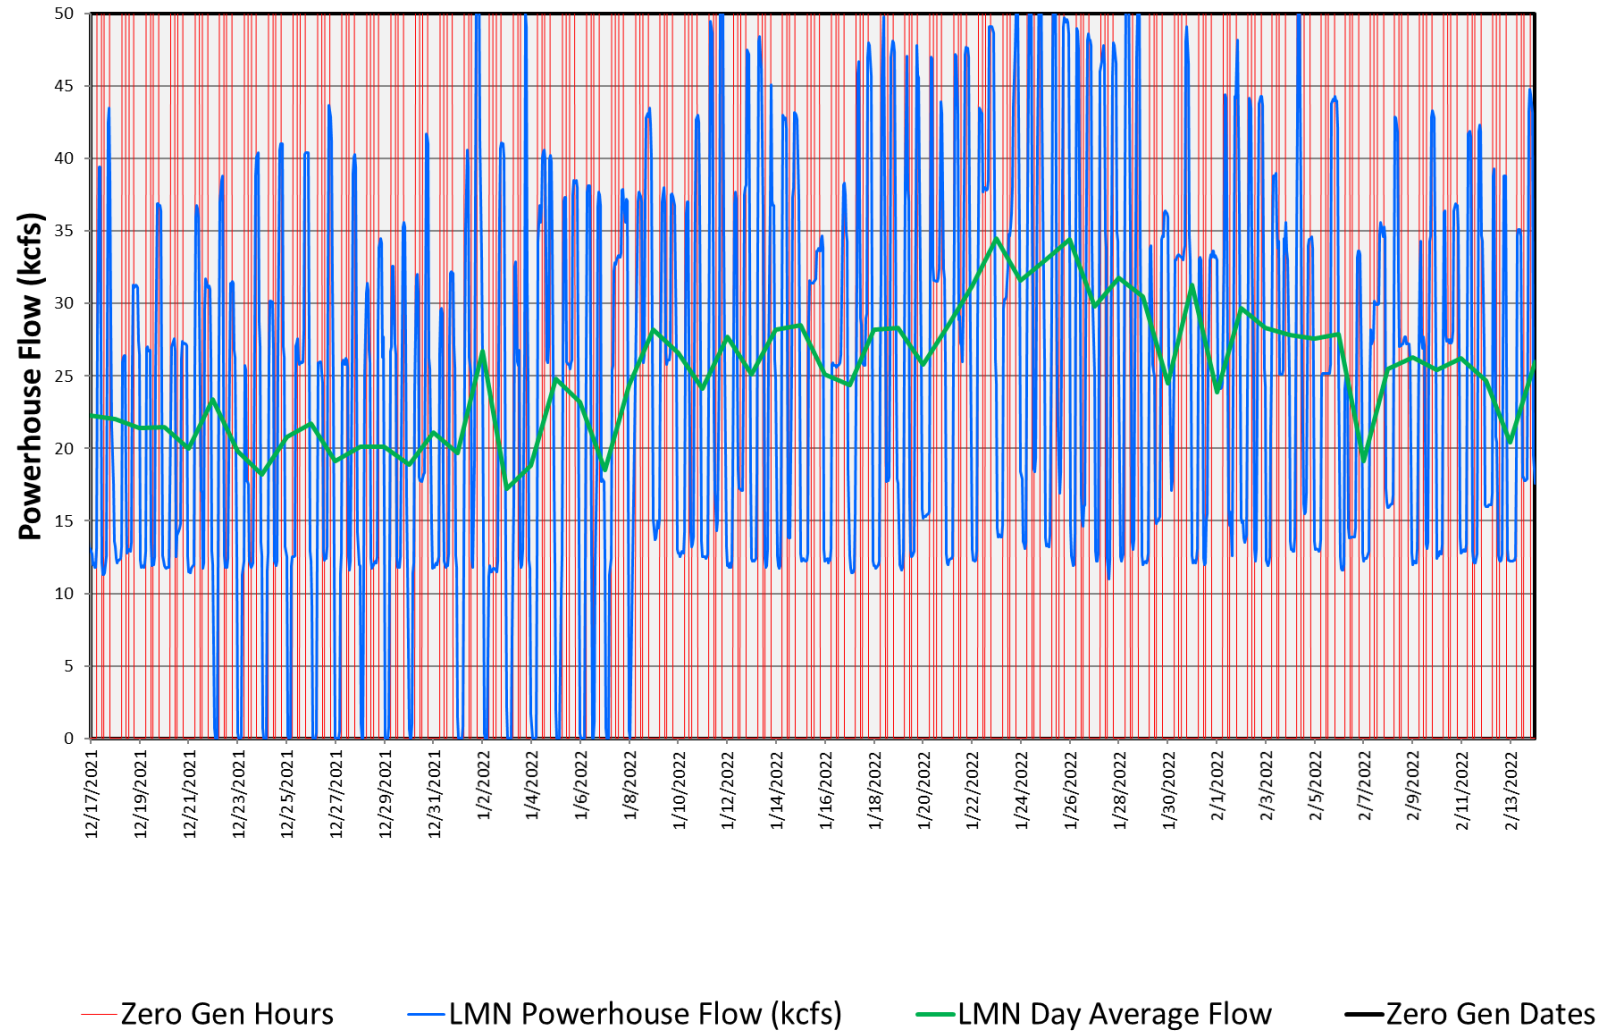


# Zero Generation Flexibility 2021-2022 Usage 12/17/2021 – 2/14/2022

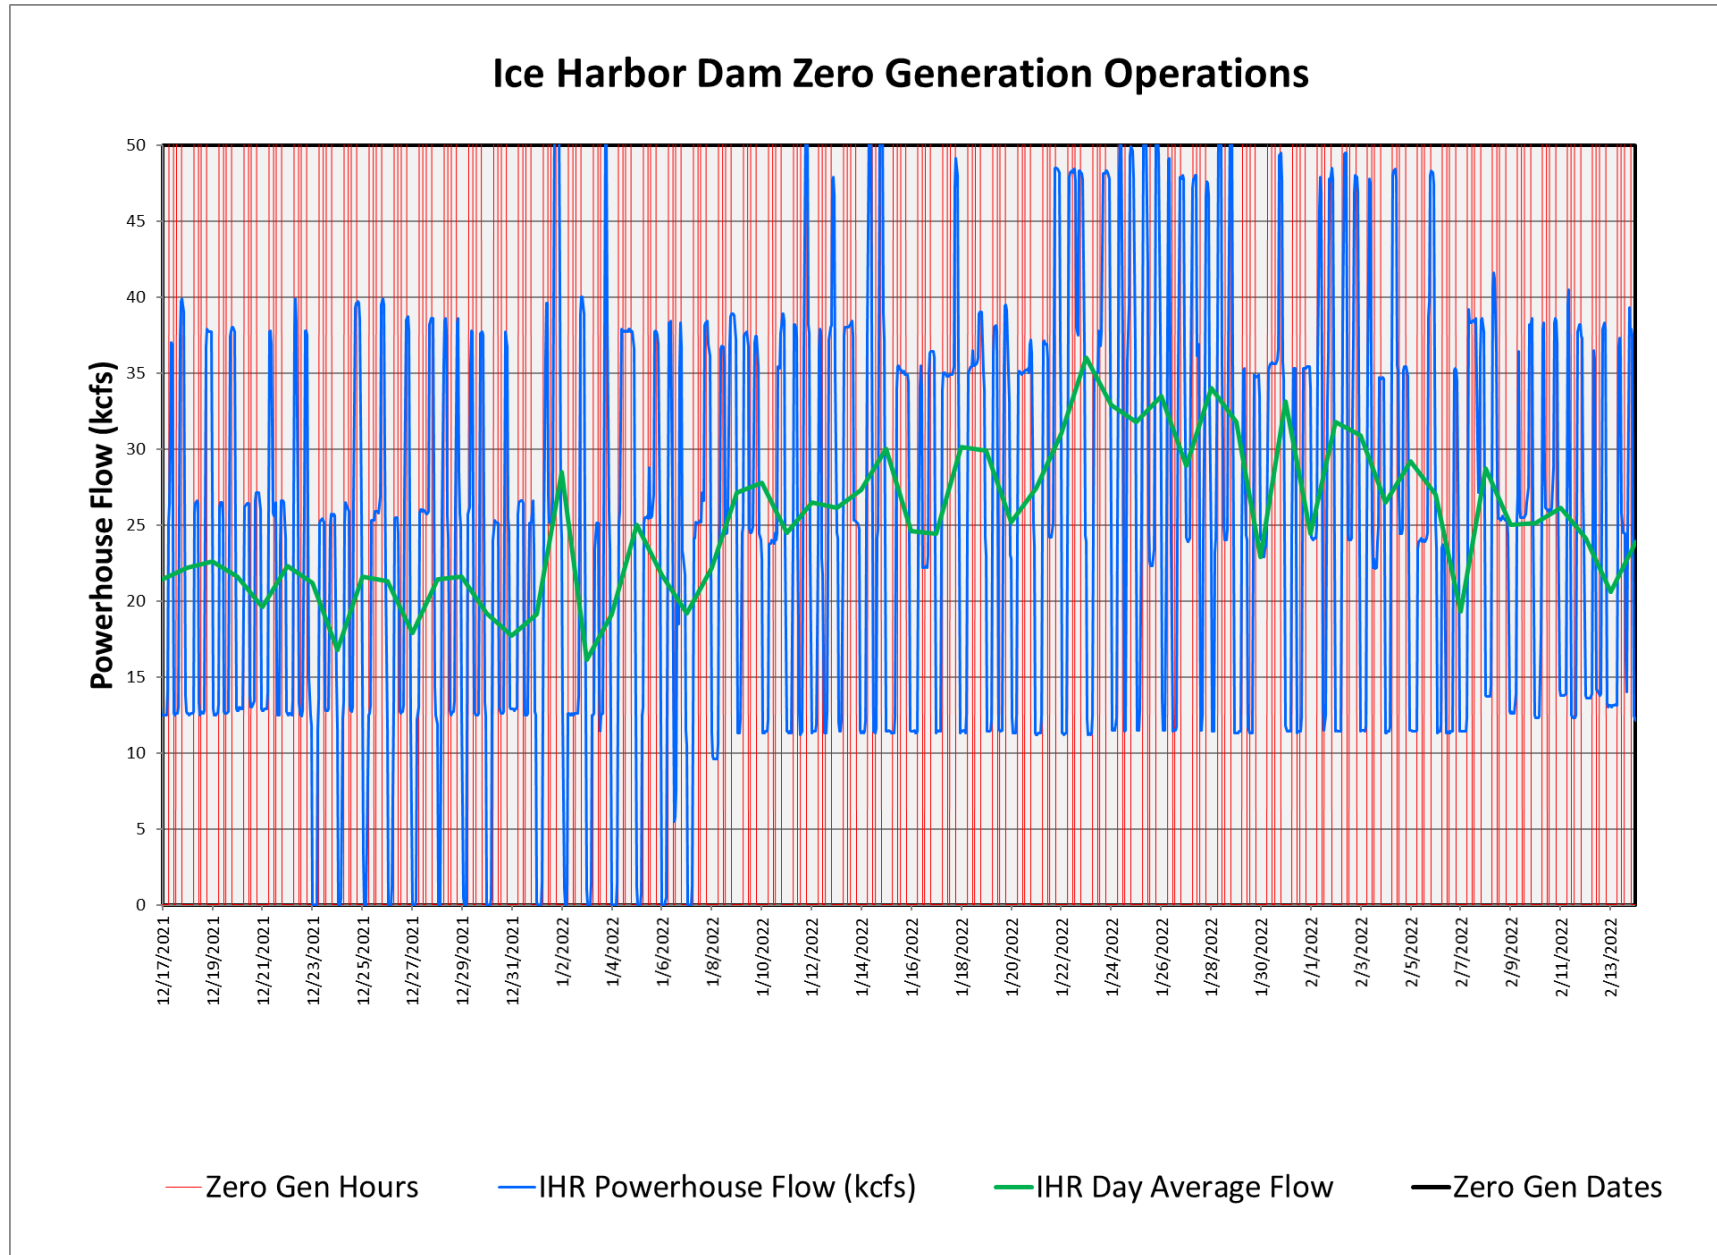

## Hourly Distribution of Zero Generation Used between 12/17/2021 and 2/14/2022

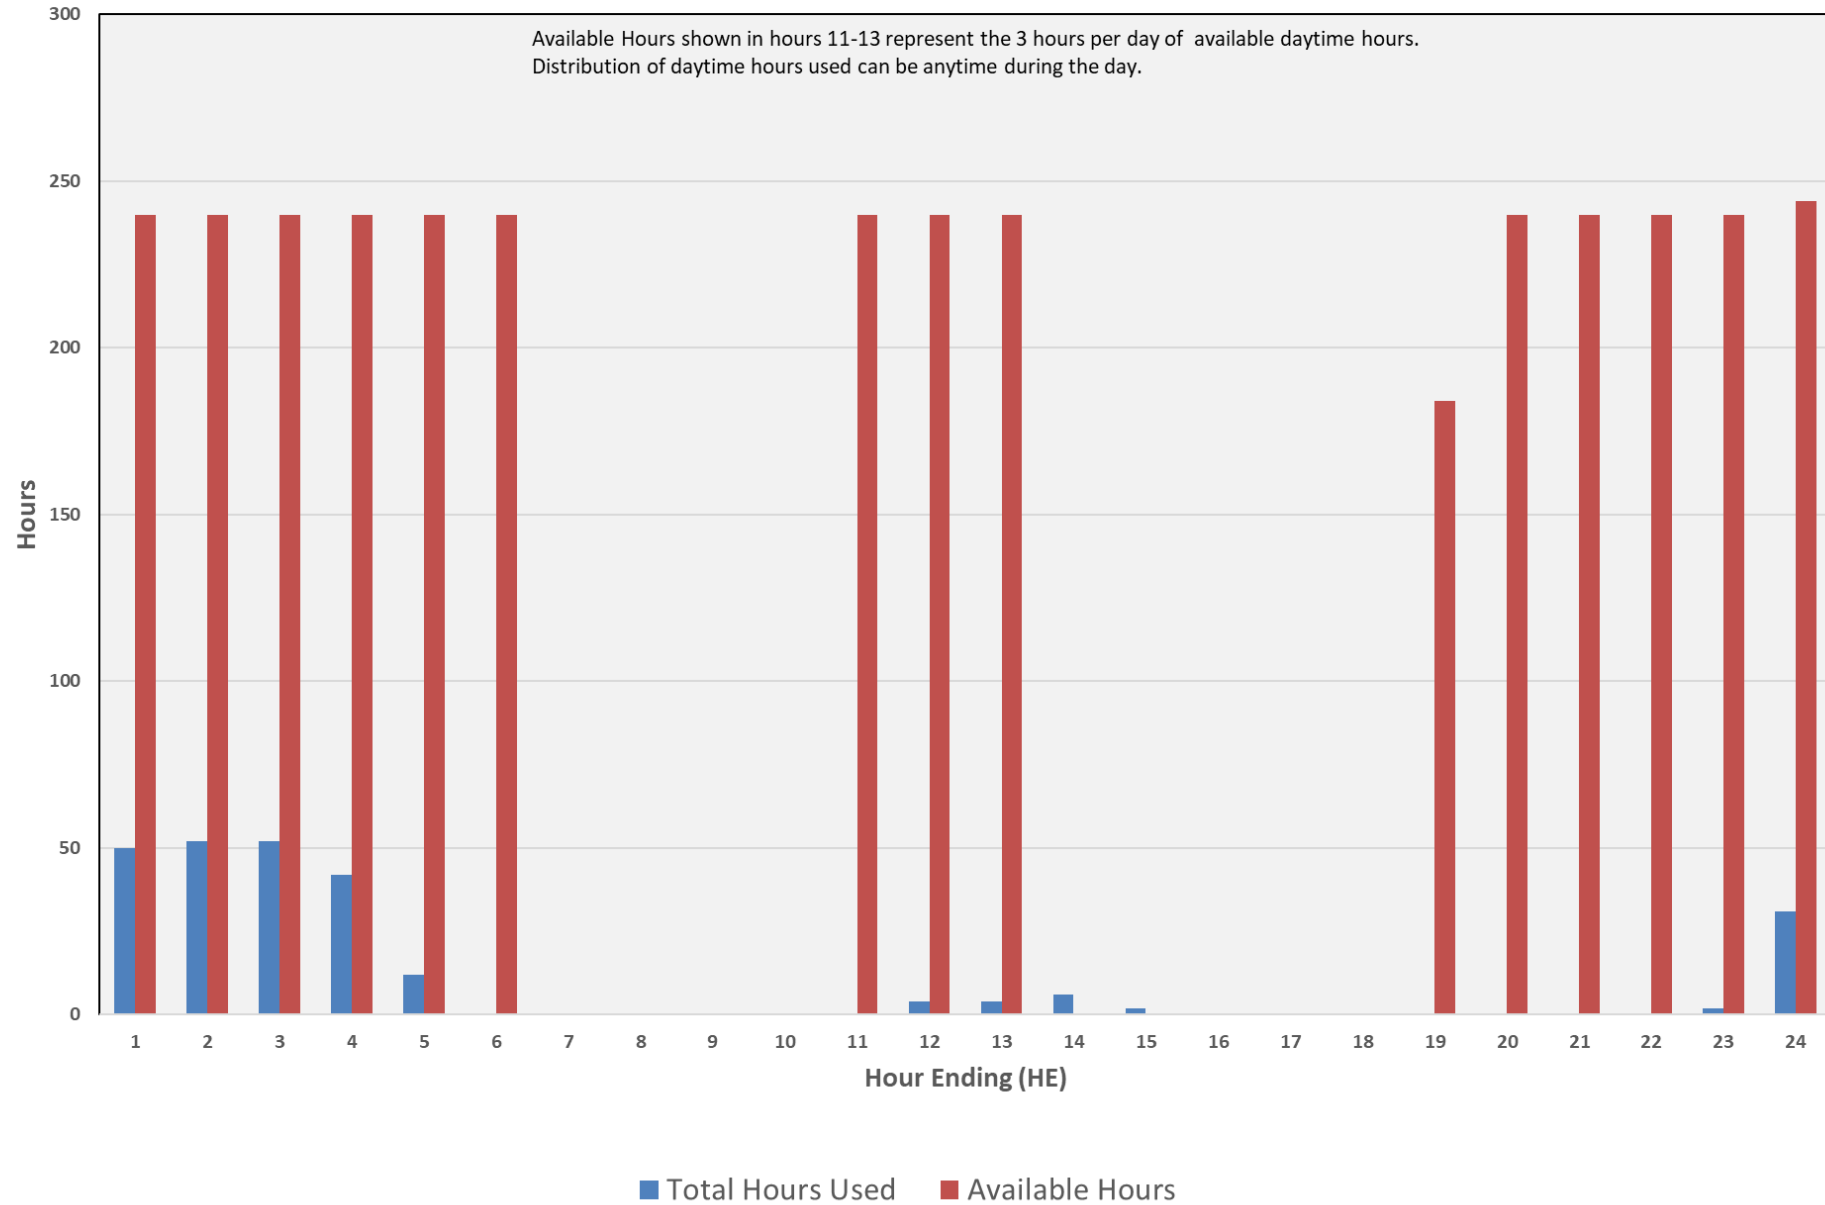

Distribution of Consecutive Hours of Use between 12/17/2021 and 2/14/2022

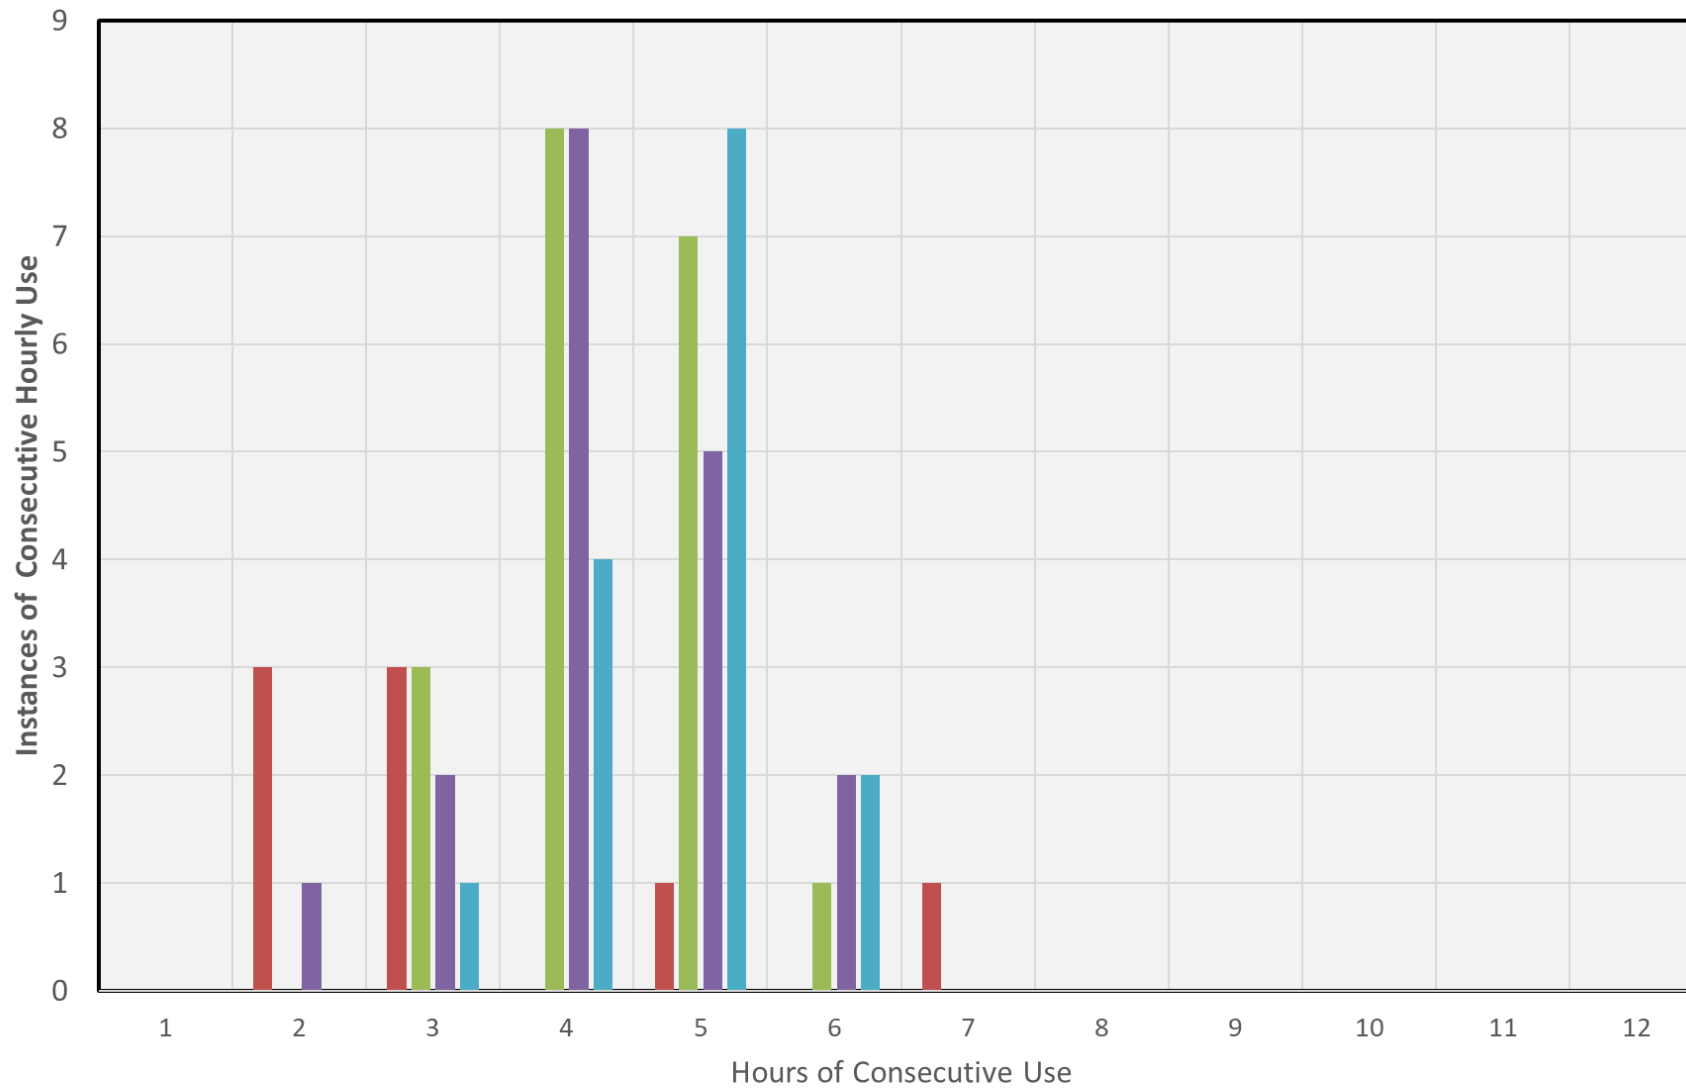

■ LWG ■ LGS ■ LMN ■ IHR

Distribution of Consecutive Use on Consecutive Days 12/17/2021 and 2/14/2022

