

MEMORANDUM FOR Biologist, Operations Division (CENWP-OD)

SUBJECT: Bonneville Project, Fishway and Fish Activities for Week 19 of 2017, which covers the period from 07 to 13 May.

1. OPERATION SUMMARY:

- a. Daily average river flows ranged from 436.8 to 454.5 kcfs. Daily average powerhouse forebay elevation ranged from 72.9 to 73.4' msl. Daily average project tailwater ranged from 28.9 to 29.9' msl. Secchi disk measurements ranged from 2.5 to 3.5'. Daily average water temperature ranged from at 53 to 54 °F.
- b. Spring spill began 10 April. Daily average spill ranged from 236.0 to 253.6 kcfs.
- c. Unit Operation. PH2 remains the priority powerhouse. Main unit drawdowns are measured every Monday and more frequently as needed.

(1) Table 1. Unit Outages.

Unit	OOS Date	RTS Date	Reason
1	0753 on 10 May	0831 on 10 May	Trash raking
2	0954 on 10 May	1123 on 10 May	Trash raking
3	0831 on 24 Feb	---	5-year overhaul
5	0911 on 09 May	1159 on 09 May	Relay work, trash raking
6	0912 on 09 May	1025 on 09 May	Relay work
7	0103 on 22 Feb	---	Annual, bank 7/8 outage, main unit breaker replacement
8	0103 on 22 Feb	---	
10	1259 on 10 May	1610 on 10 May	Trash raking
16	0709 on 27 Mar	---	4-year overhaul

- d. Fish Units. Second Powerhouse fish units provide attraction flow for the Washington Shore (WS) fish ladder.

(1) Unit F2 was placed in reserve to float debris from 1957 to 2312 on 09 May and from 1825 to 1856 on 12 May.

(2) Table 2. Fish unit drawdowns, in feet.

Date	F1	F2
5/7	0.4	1.9
5/8	0.2	0.3
5/9	0.3	7.7
5/10	0.4	0.6
5/11	0.3	0.3
5/12	---	14.0
5/13	0.2	1.5

2. MAINTENANCE ACTIVITIES:

a. Auxiliary Water System Closures.

(1) FV3-7 was closed for cleaning from 0710 to 0800 on 08 May and from 0815 to 0830 on 13 May.

(2) FV3-9 was closed for cleaning from 0710 to 0800 on 08 May and from 0759 to 0805 on 13 May.

b. STS/VBS inspections. None.

c. Dewatering and Fish Salvages. None.

3. RESEARCH:

a. CRITFC – Adult sampling. Annual adult sampling in the AFF began on 17 April.

b. NOAA – PIT evaluation. A biological study of the B2CC PIT antenna occurred 24-28 April.

c. Normandeau – Fish counting. Visual counting began on 01 April.

d. PNNL – FGE testing. A hydroacoustic study at the PH2 gatewells as part of biological testing of the FGE mods began on 10 April.

e. PSMFC – Smolt Monitoring. SbyC is active for NOAA. 200 yearling Chinook and steelhead were examined for GBT: seven fish (3.5%) were observed with symptoms. Fallbacks recorded crossing the separator bars: 27 steelhead and 6 unknown salmonids. More details can be found on the [FPC web page](#).

f. USDA – Pinniped and avian hazing. Deck-based pinniped hazing began 01 March, avian hazing on 01 April.

g. USFWS – Fish Health Survey. Juvenile and adult shad, and juvenile hatchery Chinook will be collected from the fish facilities as part of the annual survey. BON mortalities will also be sent to the USFWS for pathogen analysis.

h. UI – Video monitoring. A DIDSON camera study began in late April to monitor fish in the UMT junction area near the new LPS extension.

4. FISHWAYS:

a. Project biologists inspected 07 – 13 May.

b. Fish passage plan observations.

(1) Table 3. FPP out of criteria items.

Date	Location	FPP Items	Cause	Response
BRADFORD ISLAND				
5/11	PH1CC	N entr diff > 2.0'	Unknown	None
5/9	PH1CC	Velocity < 1.5 fps	Unknown	None
CASCADES ISLAND				
5/7-13	CI entrance	Entrance diff < 1'	Conduit sensor	TR submitted
WASHINGTON SHORE				
5/8-12	Weir 37	Water over weir > 1.1'	Sampling in AFF	None
5/7,12,13	Weir 38	Water over weir < 0.9'	Unknown	None

- (2) FG3-3 is currently open and unplugged. The diffuser cannot be repaired until the north PH1CC area is dewatered. The next opportunity will be the 2017-18 winter maintenance period. It should be closed below tailwaters of 8.2' msl.
- (3) The FG3-4 diffuser shaft was found to be vibrating unusually. The diffuser was closed on 29 Dec 2017 to prevent further damage to the gate. The next opportunity for repair is the 2017-18 winter maintenance period.
- (4) FG3-8 was found to be banging loudly on 11 May. It was closed until repairs can be made. It should be open above tailwaters of 28.2' msl.
- (5) FG3-5 has been repaired.
- (6) Bonneville had the majority of its avian lines broken due to the ice storm (not including the lines that were already removed for the spillway work). These broken lines will be replaced when high flow conditions reduce to a level that allows safe access to these tailrace locations.

c. Adult Fishways.

- (1) The AFF remains in service.
- (2) Sensor calibration occurred on 11 May.
- (3) SLEDs are installed in all fishway entrances.

d. Juvenile Fishways.

- (1) The ITS remains in service.
- (2) The hydro-cannon is on.

- (3) The B2CC remains open.
- (4) The DSM remains in service.

e. Lamprey Fishways.

- (1) The Bradford Is, Cascades Is, and WA shore AWS LPSs remain in service.
- (2) The NDE LFS/LPS remains out of service until pumps are installed.

f. Avian Monitoring. Bird counts are made between 01 April and 31 October.

Date	Gulls	Cormorants	Terns	Wh. Pelicans	Grebes
5/7	35	0	0	0	0
5/8	22	0	0	0	0
5/9	39	0	0	0	0
5/10	17	0	0	0	0
5/11	8	0	0	0	0
5/12	---	---	---	---	---
5/13	1	0	0	0	0


5. WATER QUALITY MONITORING:

a. Fishway Temperatures. Temperatures are taken from 01 March through 30 November. Forebay temperatures can be found [online](#).

(1) Table 4. Average daily fishway water temperatures (Fahrenheit).

Date	Forebay	Fishways				Lamprey		
		Brad. Is.	WA shore	AFF	SMF	BI LPS	WA LPS	CI LPS
5/7	53.1	52.5	52.1	52.2	53.2	53.2	51.7	52.4
5/8	53.7	53.1	52.7	52.8	53.7	54.0	52.4	53.0
5/9	53.9	53.4	53.0	53.2	54.0	54.3	52.7	53.3
5/10	54.0	53.5	53.0	53.2	54.1	54.4	53.1	53.4
5/11	54.1	53.5	53.1	53.3	54.2	54.1	52.7	53.1
5/12	54.0	53.4	53.0	53.2	54.1	53.9	52.6	N/A
5/13	54.1	53.5	53.1	53.3	54.2	53.9	52.6	N/A

(2) Figure 1. Graph of fishway water temperatures (Fahrenheit).

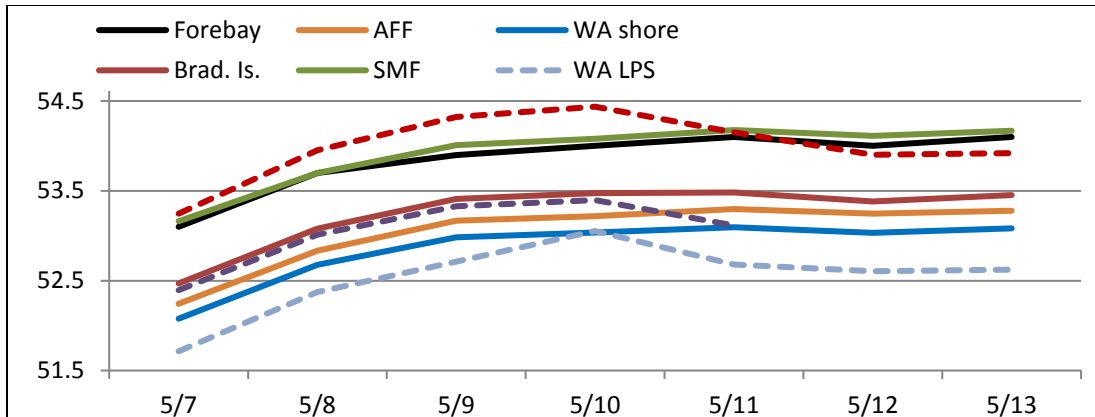

b. Zebra Mussel Monitoring. No signs of colonization were observed this reporting week.

6. CONSTRUCTION:

a. Equipment installation for a biological study of the FGE mods at PH2 began 07 March and continues through 10 May.

7. HAZMAT, SPILLS AND CLEANUP: Nothing to report.

8. TELETYPES CURRENTLY IN EFFECT:

- a. A teletype sent 06 April states effective 10 April – 31 August, operate BON pursuant to the 2017 FOP, as described within.
- b. A teletype updated on 09 May provides spill caps and lack of load spill conditions to be used from 0000 on 01 April until further notice.
- c. A teletype sent on 11 May requests Bonneville operate with an instantaneous maximum release of 470 kcfs for flood control.

PATRICK DUYCK
 Operations Manager (Acting)
 Bonneville Project