

MEMORANDUM FOR Biologist, Operations Division (CENWP-OD)

SUBJECT: Bonneville Project, Fishway and Fish Activities for **Week 26** of 2022, which covers the period from **19 to 25 June 2022**.

1. OPERATION SUMMARY:

- a. Daily average river flows ranged from 405.4 to 440.9 kcfs. Daily average powerhouse forebay elevation ranged from 73.2' to 74.1' msl. Daily average project tailwater ranged from 27.4' to 29.4' msl. Secchi disk measurements ranged from 1.5' to 3.0'. Daily average water temperature ranged from 57 to 58°F.
- b. Daily average spill ranged from 196.4 to 238.3 kcfs.
- c. Unit Operation: **PH2** remains the priority powerhouse. Main unit drawdowns are measured every Monday and more frequently as needed.

- **Table 1. Main Unit Outages**

Unit	OOS	RTS	Reason	Duration
13	1628 on 18 Feb	---	F.O., Generator Ground	---
17	0719 on 18 Apr	---	P.O., 4-Year Overhaul	---
9	0853 on 21 June	1034 on 21 June	F.O., Deluge Trip	1 hour, 41 mins
10	0853 on 21 June	1153 on 21 June	F.O., Deluge Trip/P.O., Trash Raking	3 hours
7	0835 on 22 June	1048 on 22 June	P.O., Trash Raking	2 hours, 13 mins

- d. Fish Units: Second Powerhouse Fish Units provide attraction flow for the Washington Shore (WS) fish ladder.

Fish Unit Outages: Fish Units are periodically placed into reserve service (RS) to float trash when debris differentials become excessive and trash raking is not possible.

- **Table 2. Fish Unit Outages.**

Unit	OOS/RS	RTS	Reason	Duration
F1	2229 on 18 June	0533 on 19 June	R.S., Nighttime Lamprey Ops	7 hours, 4 mins
F2	1818 on 19 June	1921 on 19 June	R.S., Float Trash	1 hour, 3 mins
F1	2230 on 19 June	0539 on 20 June	R.S., Nighttime Lamprey Ops	7 hours, 9 mins
F2	0654 on 20 June	0811 on 20 June	R.S., Float Trash	1 hour, 17 mins
F2	2229 on 20 June	0729 on 21 June	R.S., Nighttime Lamprey Ops	9 hours
F1	2229 on 21 June	0530 on 22 June	R.S., Nighttime Lamprey Ops	7 hours, 1 min
F2	1816 on 22 June	1901 on 22 June	R.S., Float Trash	45 mins
F2	2228 on 22 June	0530 on 23 June	R.S., Nighttime Lamprey Ops	7 hours, 2 mins
F1	2229 on 23 June	0529 on 24 June	R.S., Nighttime Lamprey Ops	7 hours
F2	1827 on 24 June	1943 on 24 June	R.S., Float Trash	1 hour, 16 mins
F1	2229 on 24 June	0531 on 25 June	R.S., Nighttime Lamprey Ops	7 hours, 2 mins
F2	2229 on 25 June	---	R.S., Nighttime Lamprey Ops	---

- **Table 3. Fish Unit Drawdowns, in Feet.**

Date	F1	F2
06/19	0.2'	7.5'
06/19	0.5'	0.3'
06/20	---	5.1'
06/20	0.4'	2.3'
06/21	0.2'	0.2'
06/22	0.2'	3.2'
06/22	---	0.1'
06/23	0.4'	0.1'
06/24	0.8'	5.9'
06/24	---	0.1'
06/25	0.3'	2.0'

2. MAINTENANCE ACTIVITIES:

- Auxiliary Water System Closures:
 - FV 5-9 was placed in manual for cleaning from 0700 to 0715 on 21 June.
 - FV 6-9 was placed in manual for cleaning from 0709 to 0721 on 21 June.
 - FV 3-7 and 3-9 was placed into manual for cleaning from 0729 to 0812 on 21 June.
 - FV 1-1 was placed in manual for cleaning from 0813 to 0819 on 21 June.
 - FV 6-9 was closed for cleaning from 0743 to 0754 on 23 June.
 - FV 3-9 was closed for cleaning from 1011 to 1018 on 23 June.
 - FV 3-7 was placed into manual for cleaning from 1233 to 1413 on 23 June.
- STS/VBS Inspections: Nothing to report.
- Dewatering and Fish Salvages: Nothing to report.

3. RESEARCH:

- Four Peaks Environmental - Fish counting contract: Daytime visual counting (0500 to 2100 PDT) began on 01 April. Night video counting (2100 to 0500 PDT) began on 15 May. Fish counts can be viewed [here](#).
- USFWS – Lamprey Metamorphosis Study: Juvenile lamprey researchers are onsite, and the work is underway.
- Pacific States Marine Fisheries Commission - Smolt Monitoring: Sample collections at the Smolt Monitoring Facility (SMF) began at 0700 on 02 March. Debris at the primary dewatering structure (PDS) and fish/debris separator ranged from moderate to heavy consisting mostly of sticks and other woody debris. Eleven steelhead and seven salmon fallbacks were observed this week. Gas Bubble Trauma (GBT) examinations began on 12 April and are typically performed two days per week through the end of spill. Results of this week's GBT examinations: 93 yearling Chinook, sub-yearling Chinook, and steelhead examined: five fish (5.4%) were observed with GBT symptoms. Please follow this link <https://www.fpc.org/currentdaily/gbtsumbybatchdate.pdf> to the FPC web page for more details. Non-salmonid GBT Monitoring was initiated this week at Bonneville with the start of summer spill operations. This effort is paired in conjunction with salmonid GBT monitoring with the goal of examining up to 50 non-salmonids (native and non-native species) per session using the same procedures and protocols employed in the salmonid GBT Monitoring Program. Results of this week's Non-salmonid Gas Bubble Trauma (GBT) examinations: 33 fish in total were examined: 1 fish (3.0%) observed with GBT symptoms. Please follow this link https://www.fpc.org/currentdaily/Summer_NS_gbtsumbybatchdate_realtime.pdf to the FPC web page for

specific details.

For research purposes, a total of 127 fin clips were obtained from Pacific lamprey macrophthalmia and eight from Pacific Lamprey ammocoetes for Columbia River Inter-Tribal Fish Commission's (CRITFC) genetic studies this week.

- d. USDA – Pinniped and Avian Hazing: Deck-based pinniped hazing started 14 March and concluded for the Spring season on 31 May. Avian hazing started 01 April.
- e. USGS TDG Monitoring: USGS placed TDG monitoring equipment back in service on Cascades Island above and below the Main Dam on 31 March. Water-quality data collection will continue through the end of spill season.
- f. CRITFC – Adult Salmonid Sampling: Adult salmonid sampling in the Adult Fish Facility (AFF) began on 21 April and typically occurs 5 days per week.
- g. CRITFC – Lamprey Translocation: Adult lamprey collection and translocation began on 08 June and will occur daily through 30 September.

4. FISHWAYS:

- a. Project biologists inspected from 19 – 25 June.
- b. Fish Passage Plan observations:

• **Table 4. FPP Items Out of Criteria.**

Date	Location	FPP Violation	Cause	Response
06/19 – 06/25	BON	Unit Priority	U13 F.O., Generator Ground	Repairs in Process
PH1				
06/19 – 06/25	PH1 ITS	S. End Gate Inoperable and Chain Gates 1a & 1b Closed	S. End Gate Inoperable, 1a and 1b Closed for Safety Reasons	W.O.
06/19 – 06/25	PH1CC	FG 2-19 Stuck in the Mostly Closed Position, Should Be Open	Mechanically Bound	W.O.
06/21	PH1CC	South Entrance/TW Diff <1.0'	Sensor Calibration Issue	W.O.
Bradford Island				
06/25	A-Branch	Weir Staff Gauge High, >1.4'	Unknown	N/A
Cascades Island				
06/19-25	CI Fishway	FG 6-11 Mechanically Bound in the Closed Position, Should Be Open	Mechanically Bound	W.O.
Washington Shore				
06/19-25	PH2CC	A2 Diffuser Stuck Mid-Travel	Unknown	W.O.
06/19	WA Shore Fishway	NUE Ent/TW Diff <1.0'	Unknown	N/A
06/19,21	WA Shore Fishway	NDE Ent/TW Diff <1.0'	Unknown	N/A
06/19-22	WA Shore Fishway	SUE Ent/TW Diff <1.0'	Unknown	N/A
06/19-23	WA Shore Fishway	SDE Ent/TW Diff <1.0'	Unknown	N/A
06/23	WA Shore Fishway	Weir 37 High, >1.4'	Unknown	N/A

- PH1 Collection Channel diffuser FG 2-19 was found mechanically bound in the mostly closed position on 02/24/22 by PH1 Mechanics. No repairs can be made until the PH1CC can be dewatered in the next

Oregon Fishway Winter Maintenance Period (winter 2023/2024).

- The Cascades Island Fishway diffuser FG 6-11 is mechanically bound in the closed position due to stripped shaft threads. A work order has been created and repairs will be made during the next Washington Shore/Cascades Island Fishway Winter Maintenance Period (winter 2022/2023).

c. Adult Fishways:

- (1) The AFF remains in service.
- (2) Sensor calibrations were conducted on 13 June.
- (3) SLEDs are installed at all locations.
- (4) Bradford Island, Cascades Island, and Washington Shore Fishways remain in service and are in “Shad Mode” due to current fish passage numbers.

d. Juvenile Fishways:

- (1) The ITS remains in service (auto-chain gates 3B, 6C, & 10B only).
- (2) The hydro-cannon remains in service.
- (3) The B2CC remains in service.
- (4) The DSM remains in service.
- (5) STSs remain in service.

e. Lamprey Fishways:

- (1) BI, CI, and WA Shore LPS’s remain in service.
- (2) The Bradford Island Wetted Wall (BIWW) remains out of service.
- (3) The PH2 Lamprey Flume Structure (LFS) remains out of service for the year.
- (4) The AFF lamprey trap and CI lamprey trap both remain in service.
- (5) Avian Monitoring: Avian counts are recorded 01 April – 31 October.

Table 5. *Avian Counts 19 – 25 June.*

Date	Gulls	Cormorants	Terns	Wh. Pelicans	Grebes
06/19	0	3	0	0	0
06/20	0	4	0	0	0
06/21	3	8	0	0	0
06/22	1	3	0	0	0
06/23	0	7	0	0	0
06/24	0	12	0	0	0
06/25	0	4	0	0	0

5. WATER QUALITY MONITORING:

a. Fishway Temperatures: Fishway temperature monitoring is currently underway.

Table 6. Bonneville Fishway Temperatures for 19 to 25 June.

Date	A-Branch	B-Branch	BI_Exit	WA_Entrance	WA_Exit	CI_Entrance	AFF	SMF	BI LPS	CI_LPS	WA_LPS	LFS
19-Jun	57.3	57.4	57.4		57.3	57.3	57.2	57.2	57.7	57.5	57.6	OOS
20-Jun	57.7	57.7	57.8		57.7	57.7	57.6	57.6	58.1	57.9	58.0	OOS
21-Jun	58.0	58.0	58.1		57.9	57.7	57.8	57.8	58.1	58.2	58.3	OOS
22-Jun	58.3	58.3	58.4		58.2		58.2	58.2		58.6	58.6	OOS
23-Jun	58.5	58.5	58.6		58.4		58.4	58.4		58.7	58.8	OOS
24-Jun	58.6	58.6	58.7		58.6		58.5	58.5		59.0	59.0	OOS
25-Jun	59.3	59.3	59.4		59.2		59.2	59.1		59.7	59.7	OOS

** The Washington Shore Entrance, Cascades Island Entrance, and Bradford Island LPS probes malfunctioned again this week and were replaced with new probes.

** The LFS was taken out of service on 16 June.

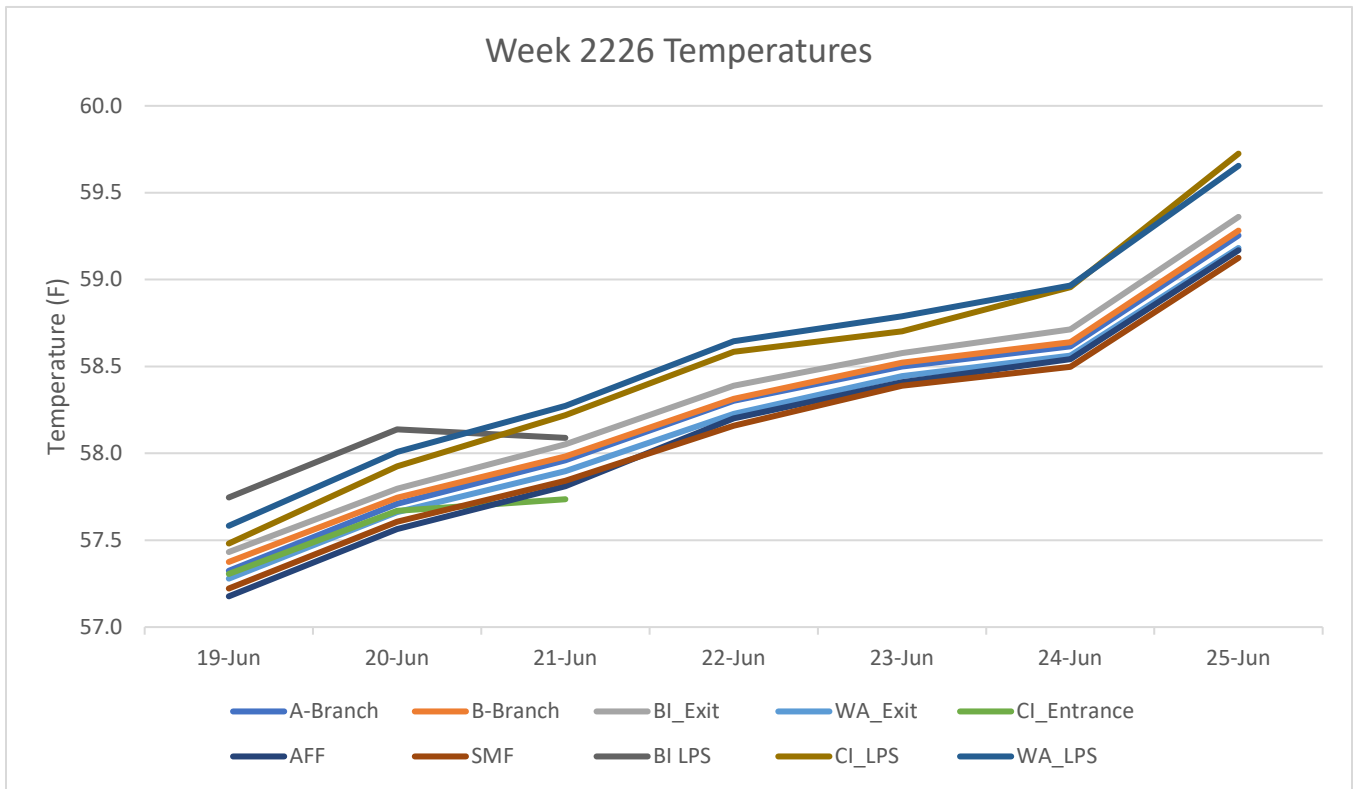


Figure 1. Average fishway temperatures for 19 to 25 June at Bonneville Lock & Dam.

b. Zebra Mussel Monitoring: No signs of colonization were observed this reporting week.

6. CONSTRUCTION: Nothing to report.

7. HAZMAT, SPILLS AND CLEANUP: Nothing to report.

8. TELETYPES CURRENTLY IN EFFECT:

- A teletype was sent on 10 June regarding Bonneville Forebay operations for treaty fishery. This operation includes Bonneville Pool operating within a 1.5-foot band, hard constraint for the periods listed below:
 - From 0600 Thursday, 16 June to 1800 Saturday, 18 June 2022
 - From 0600 Monday, 20 June to 1800 Friday, 24 June 2022
 - From 0600 Monday, 27 June to 1800 Friday, 01 July 2022

The goal of this operation is to limit pool fluctuation to avoid debris in fishing nets, reduce rapid water drops that may entangle nets, minimize boat access problems, and avoid nets being torn from their anchors. Please see teletype BON R 061022 1244 for more details.

- A teletype was sent 30 June regarding the Bonneville Forebay operations for treaty fishery. This operation includes Bonneville Pool operating within a 1.5-foot band, hard constraint for the periods listed below:
 - From 0600 Monday, 04 July to 1800 Friday, 08 July 2022
 - From 0600 Monday, 11 July to 1800 Friday, 15 July 2022

The goal of this operation is to limit pool fluctuation to avoid debris in fishing nets, reduce rapid water drops that may entangle nets, minimize boat access problems, and avoid nets being torn from their anchors. Please see teletype BON R 063022 1252 for more details

- A teletype was sent on 13 June detailing Summer Spill Operations for fish passage at Bonneville Lock & Dam. Effective Thursday 16 June at 0001 HRS, through Wednesday August 31 at 2359 HRS, operate Bonneville Dam in accordance with the 2022 Fish Operations Plan (FOP) to provide Summer Spill for fish passage as described below:
 - Pursuant to FOP Table 4, the 2022 Summer Spill Operation at Bonneville Dam is as follows:
 - June 16 at 0001 HRS to August 14 at 2359 HRS: Target Spill = 95 kcfs
 - August 15 at 0001 HRS to August 31 at 2359 HRS: Target Spill = 50 kcfs
 - Distribute spill according to spill patterns in the 2022 Fish Passage Plan (FPP) Table BON-16. Follow the pattern spill rate that is closest to the target. Actual spill may range +/-3 kcfs from the target from the target due to Project operational limitations.
 - Continue to operate the Powerhouse 2 Corner Collector (B2CC) throughout Summer Spill, then close B2CC within one hour of the end of spill on 31 August. B2CC operating criteria are found in the FPP Section 2.3.2.5.v.
 - Maintain spill at the FOP target as long as it does not exceed the spill cap in Level 1 of the most recent Spill Priority List Teletype. Do not spill above the Level 1 Spill Cap except as required during involuntary spill, pursuant to the Spill Priority List Teletype.
 - If river flow is too low to maintain FOP spill and minimum generation requirements in FOP Table 1, operate at minimum generation and spill the remainder of outflow.
 - During periods of low flow, it may be necessary to operate outside the minimum operation range defined in FOP Table 1 in order to maintain reserves for transmission reliability, as defined below.
 - If notified that BPA has declared a “Transmission System Reliability Need” or “Transmission System Emergency”, adjust operations as instructed by BPA Hydro Scheduling or Transmission Dispatch (per FOP Section 4.4).
Please see Teletype BON R 061322 0955 for more details.
- A teletype was sent on 30 June describing the Spill Priority List to be used until further notice. The teletype outlines maximum spill level estimated not to exceed the applicable TDG water quality standard and lack of load spill levels and order to which should be spilled. Please see teletype BON R 063022 1339 for more details.

MICHAEL ADAMS, P.E.
Operations Project Manager
Bonneville Project