

# The Dalles Dam Fishway Status Report

9/5/21

Inspection Period: 8/29-9/4/2021

## THE DALLES DAM



US Army Corps  
of Engineers  
Portland District

The Dalles Project-Fisheries  
P.O. Box 564  
The Dalles, OR 97058-9998  
Phone: 541-506-3800

<b>The Dalles Dam</b>	<b>Inspections OOC</b>	<b>Criteria Limit</b>	<b>Total Number of Inspections:</b> 14		<b>Temperature:</b> 68.9 °F
			<b>Comments:</b> status quo		<b>Weekly Ave. Secchi:</b> 5.0

### NORTH FISHWAY

Exit differential	0	≤ 0.5'		
Count station differential	0	≤ 0.3'		
Weir crest depth	0	1.0' ± 0.1'		
Entrance weir N1	0	1.0' - 2.0'	Weekly average	9.5
Entrance Differential	0	depth (≥ 8')	Weekly average	1.4
Entrance weir N2	0	Closed		
PUD Intake differential	8	≤ 0.5'	Aquatic Weed buildup over weekend.	

### EAST FISHWAY

Exit differential	0	≤ 0.5'		
Removable weirs 154-157	0	Per forebay		
Weir 158-159 differential	0	1.1' ± 0.1'		
Count station differential	0	≤ 0.3'		
153 Weir crest depth	0	1.0' ± 0.1'		
Junction pool weir JP6	0	> 7.0'		
East entrance differential	0	1.0' - 2.0'	Week ave.	1.5
Entrance weir E1	0	No criteria		
Entrance weir E2	0	depth (≥ 8')	Week ave.	12.1
Entrance weir E3	0	depth (≥ 8')	Week ave.	12.6
Collection channel velocity	0	1.5 - 4 fps	2.55 fps 8/26/21	
Transportation channel velocity	0	1.5 - 4 fps	no data fps 8/26/21	
North channel velocity	0	1.5 - 4 fps	2.69 fps 9/2/21	
South channel velocity	0	1.5 - 4 fps	2.47 fps 8/26/21	
West entrance differential	0	1.0' - 2.0'	Old SCADA	Week ave. 1.5
Entrance weir W1	0	depth (≥ 8')		Week ave. 9.9
Entrance weir W2	0	depth (≥ 8')		Week ave. 9.9
Entrance weir W3	0	No criteria	Closed	
South entrance differential	0	1.0' - 2.0'		Week ave. 1.4
Entrance weir S1	0	depth (≥ 8')		Week ave. 9.2
Entrance weir S2	0	depth (≥ 8')		Week ave. 9.4

### JUVENILE PASSAGE

Sluiceway operation	0	Units 1,8, 18	Gates over MU1/1-2-3,MU8/1-3,MU18-2 open	
Turbine trashrack drawdown	0	<1.5', biwklly	8/15/21, all gatewells in criteria.	
Spill volume/pattern	0	1 to 8	Spill closed 9/1/21	
Turbine Unit Priority	0	per FPP		
Gatewells	0	Weekly	No fish present or mortality 9/2/2021	

## OTHER ISSUES:

### Current Unit Outages

- T10 (MU19 & 20) FOOS through 10/27/2022 due to acetylene levels
- MU12 OOS 0001 4/12/2021 – 1700 10/27/2022 for Annual & Cooler Upgrades
- MU15 OOS 0630 8/2/2021 – 1700 10/7/2021 for Overhaul, Top Plate, Strainer, & T8 Doble Testing
- MU16 OOS 0001 8/2/2021 – 1700 9/9/2021 for Annual, Strainer, & T8 Doble Testing
- MU19 OOS 0630 6/27/2021 – 1700 10/27/2022 for Top Plate Cover Upgrade
- MU21 OOS 0630 7/12/2021 – 1700 9/9/2021 for Crane Rail Replacement
- MU22 OOS 0630 7/12/2021 – 1700 9/9/2021 for Crane Rail Replacement

### Maintenance

Contractor completed work on fish unit bus overheating problem. Review of bus FCLR1 of results show improvements. Both fish units can operation on FCLR1. Spillway assessment (MRER); Spillgates 1- 9 rehab date estimate 2034. Includes replacement of spillbay 9 trunnion pin repair PUD intake rake in service with temporary power. Transferring rake to N Wasco PUD in progress. Five of 6 east fishway collection channel dewatering pumps removed for repair/rehab. Repair and install planned for Sept. Fishway automation replacement on hold from lack of staff. East exit, east and south entrances complete. West and north operating with old system. Oil boom protecting east exit became detached and is temporarily secured. Plans to remove in September and possible redesign. Calibrations of fishway gates. 8/31, all gates within criteria. Gates E-3 and S2 out of calibration and under examination by TDE.

### Predators

Cormorants successfully foraging, gulls present with little foraging, mergansers present-we speculate are here for the emerging juvenile shad

### Research/Construction/Contractors


Fish counters through Oct30. No issues to date.  
AWS intake trashrack - EDR funded for FY21 to investigate solution for debris plugging issue. PDT meetings in progress.  
Efforts being made regarding investigating MOP operation at fishways  
Fish Accords Lamprey Passage plan for The Dalles ongoing at 30% DDR  
PITAGS north and east fishladder data collection at count stations continues.  
Fish unit rehab - Phase 1A on hold. Planning operation with AWS backup water supply during construction.  
Northern Pikeminnow Management Program appears to have concluded w/1378 native pikeminnow removed YTD  
PSMFC concluded juvenile sampling  
USDA concluded Picivorous bird hazing  
Crane rail replacement underway on intake deck units 20-22. Plans to start on units 1-4 last Sept 20. Sluiceways unit 1 to move to unit 5 open.

### Fishway Operations

Ice Trash sluiceway opened 24/7. MU1/1-2-3, MU 8/1-2, MU18/2  
East and north fish ladders in full operation per Fish Passage Plan.  
New automation installed at east exit, east entrance and south entrance working well with minor adjustments.  
Spillway gates 2-8 open at 30% river flow. Spillgates 1-5 will be tagged out of service for spillgate inspection 8/30 and 31. FPOM coordinated.

Approved by: Ron Twiner, Operation Project Manager, The Dalles Dam


New Avian Lines and laser deterrent zones

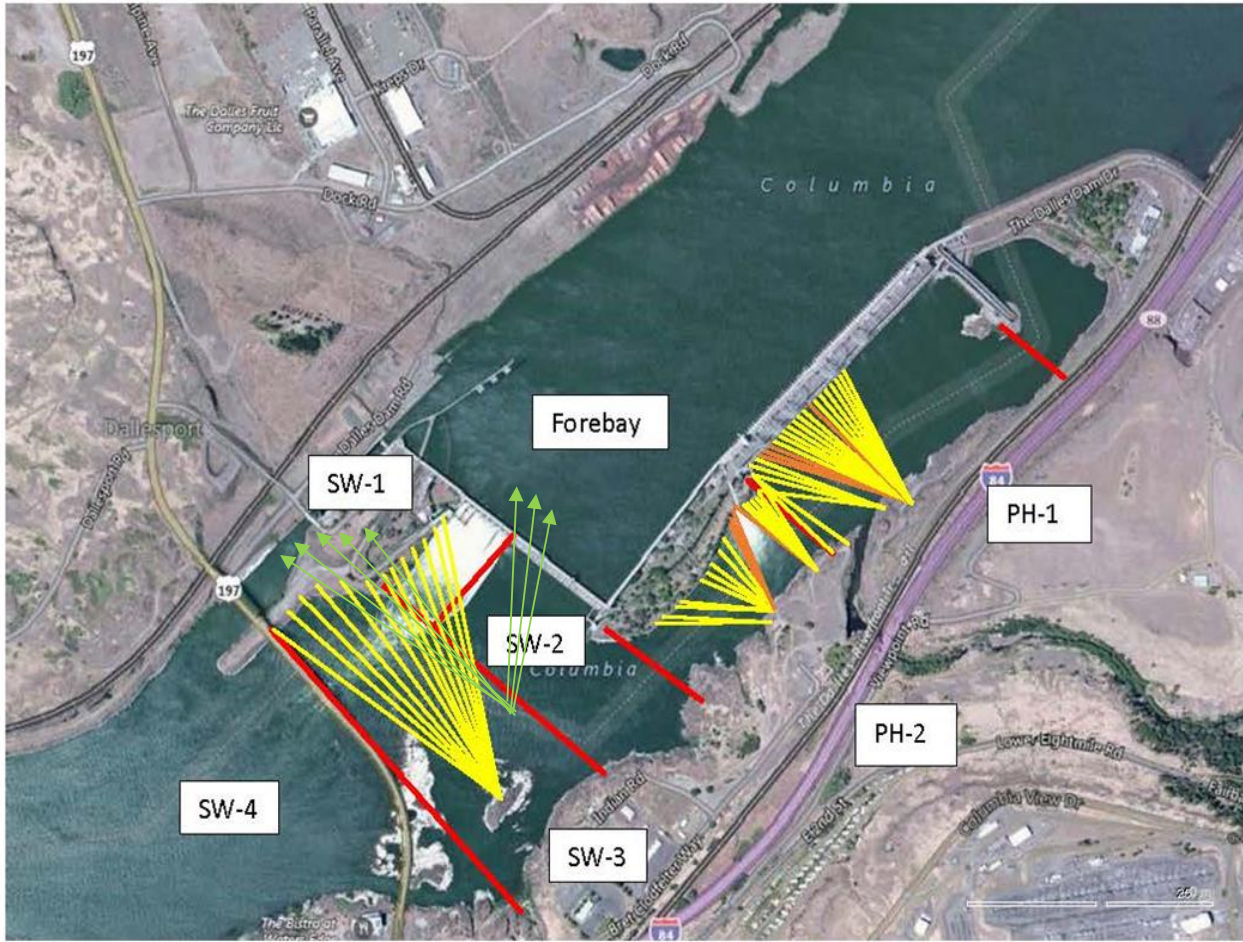


Red lines = avian zones

Yellow lines = current wires

Orange lines = down or missing wires

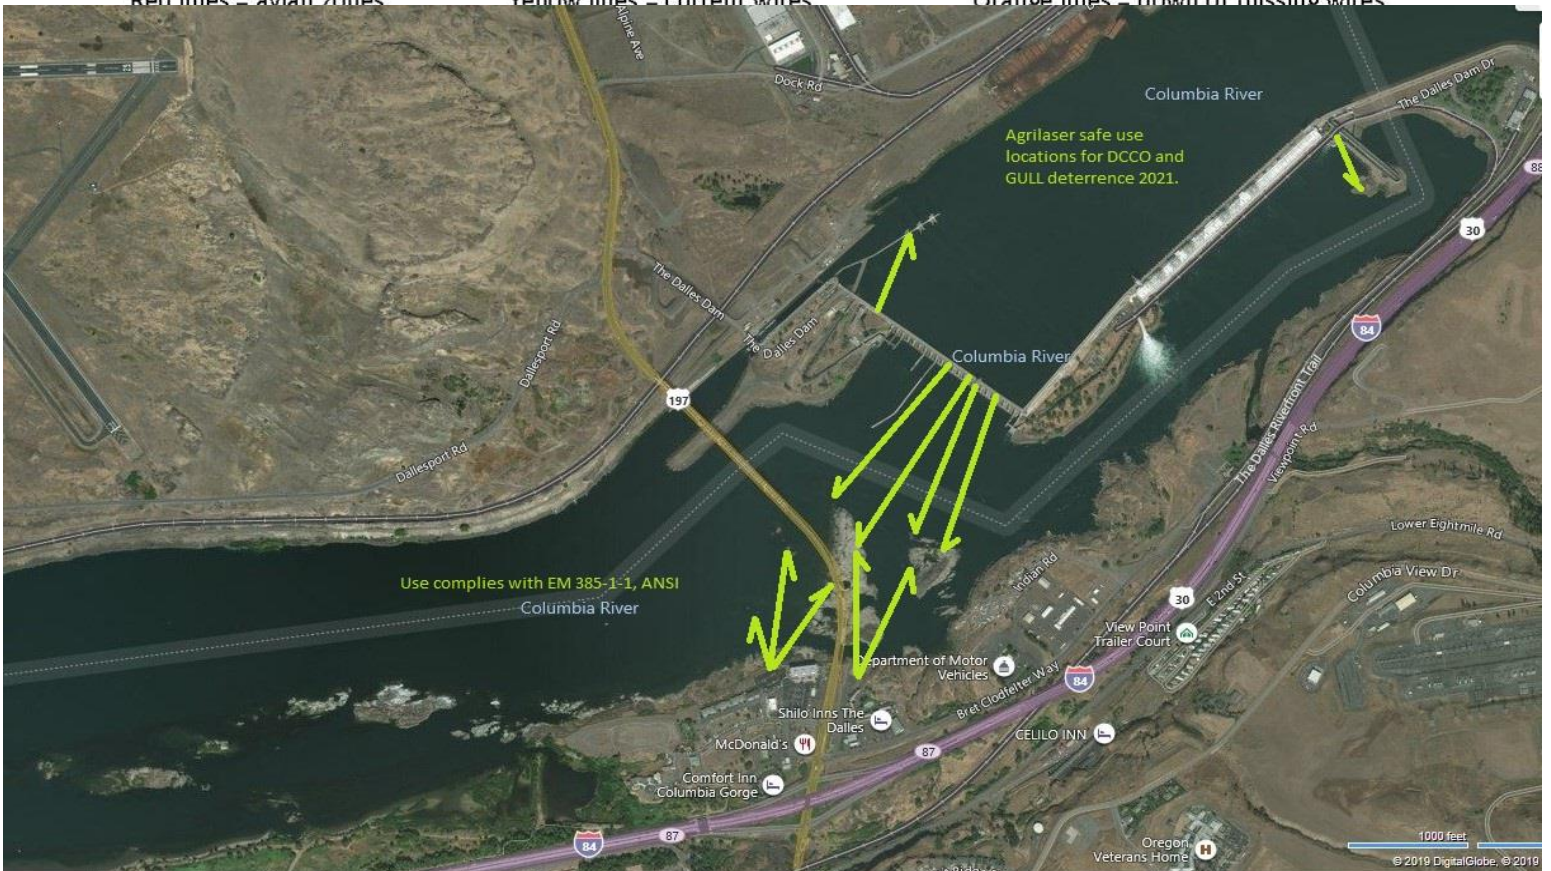


### Piscivorous Avian Activity

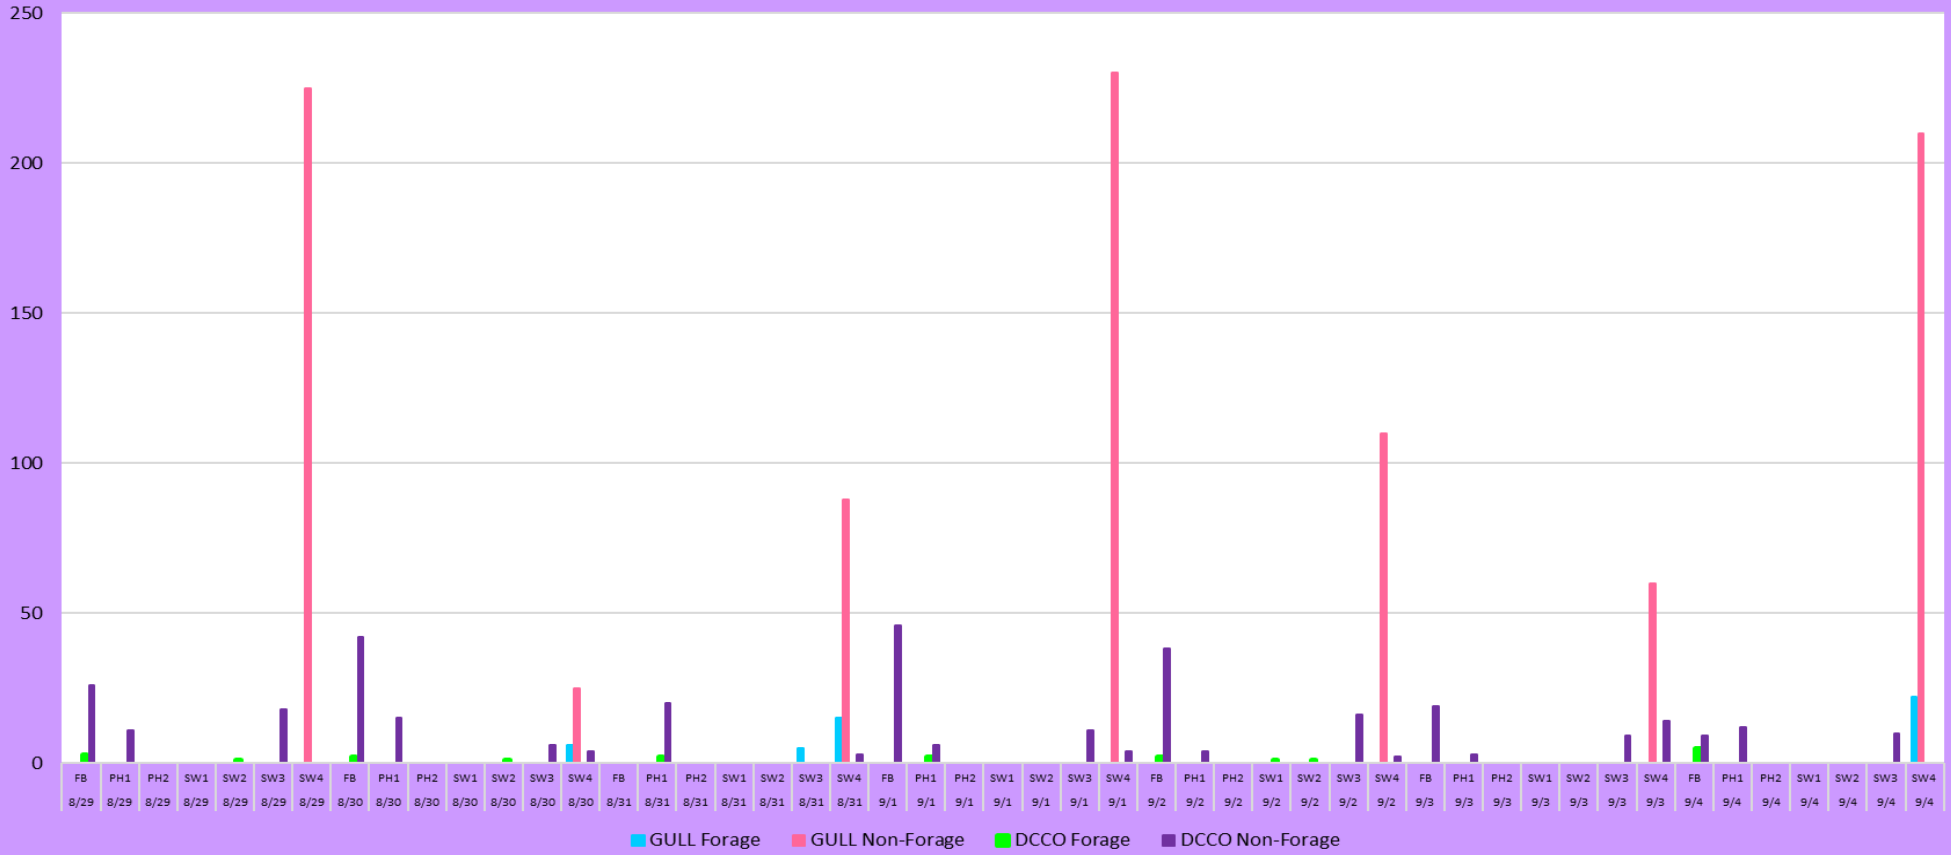

### Adult Fish Ladders-River Temperatures

— East Count Station    — North Count Station    — North Entrance    ● Current USGS Daily Average    ▲ USGS Daily Average (2007-2020)

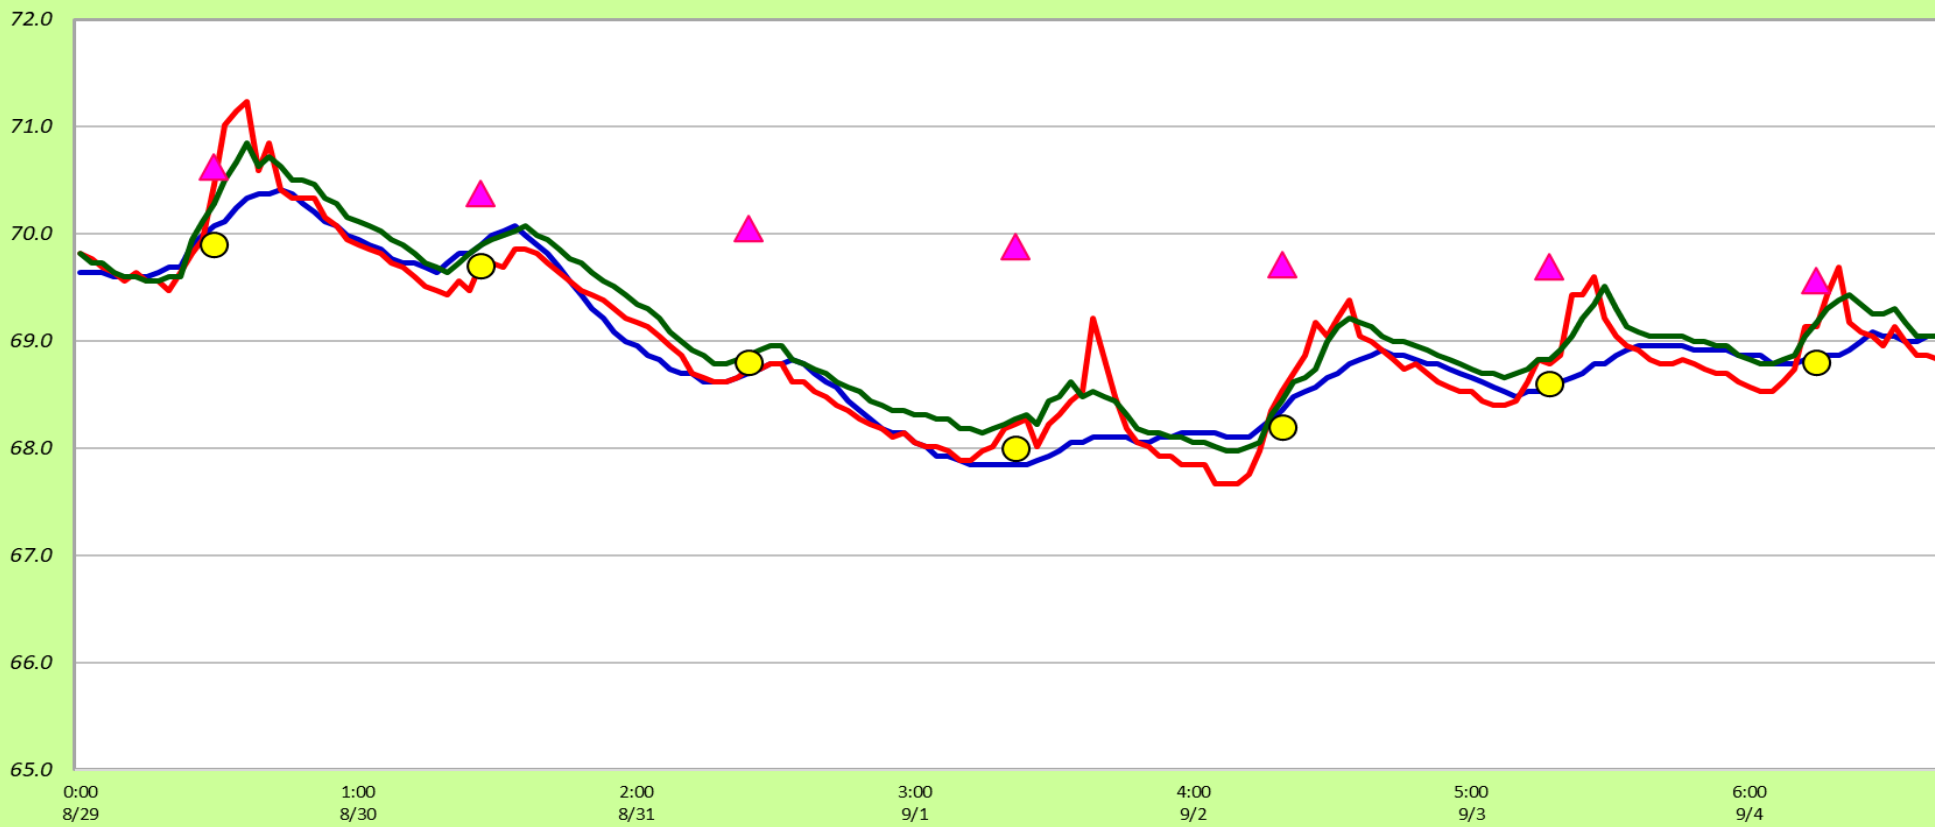

Secchi:		°F
5.0	Sun	69.9
5.0	Mon	69.7
5.0	Tue	68.8
5.0	Wed	68.0
5.0	Thurs	68.2
5.0	Fri	68.6
5.0	Sat	68.8
5.0	AVG	68.9

The Dalles Dam Daily Readings and Averages for  
Temperatures, Secchi, Entrances, and Spill

E1 and W3 no criteria  
out of criteria

Date:	North Ladder		East Ladder											
	Differential	N1 Depth	East Entrance					West Entrance				South Entrance		
			Differential	E1 Depth	E2 Depth	E3 Depth	JP 6	Differential	W1	W2	W3	Differential	S1	S2
8/29	1.2	8.6	1.6	4.2	12.0	12.8	10.1	1.5	10.1	10.1	-2.6	1.5	8.7	9.0
	1.4	9.5	1.4	4.5	12.3	13.2	10.5	1.5	10.1	10.1	-2.5	1.4	9.2	9.4
8/30	1.3	9.7	1.5	4.7	11.9	13.0	10.7	1.5	10.0	10.0	-2.0	1.5	9.0	9.2
	1.3	9.7	1.3	5.4	12.6	13.7	11.4	1.5	10.1	10.1	10.1	1.5	9.3	9.5
8/31	1.2	9.7	1.7	3.8	11.4	12.5	9.8	1.4	10.1	10.1	1.0	1.6	8.7	8.9
	1.2	9.5	1.5	3.6	11.8	12.8	9.6	1.3	10.0	10.0	-2.9	1.5	8.5	8.7
9/1	1.5	9.4	1.3	6.4	11.9	12.7	10.4	1.5	9.8	9.8	-2.4	1.4	9.4	9.5
	1.3	9.7	1.3	6.5	12.0	12.8	10.5	1.5	9.7	9.7	-2.3	1.4	9.3	9.4
9/2	3.1	9.6	1.4	6.6	11.8	12.6	10.5	1.5	9.7	9.7	-2.2	1.3	9.6	9.8
	1.3	9.5	1.5	6.4	12.0	12.0	10.4	1.6	9.6	9.6	-2.4	1.3	9.5	9.6
9/3	1.3	9.6	1.4	6.6	12.4	12.2	10.6	1.6	9.8	9.8	-2.2	1.3	9.7	9.8
	1.3	9.6	1.4	6.8	12.5	12.3	10.7	1.5	9.7	9.7	-2.1	1.3	9.8	10.0
9/4	1.3	9.5	1.4	6.7	12.4	12.2	10.6	1.6	9.6	9.6	-2.4	1.4	9.4	9.6
	1.3	9.6	1.5	6.3	12.0	11.8	10.2	1.6	9.6	9.6	-2.5	1.4	9.3	9.5
<b>AVG:</b>	<b>1.4</b>	<b>9.5</b>	<b>1.5</b>	<b>5.6</b>	<b>12.1</b>	<b>12.6</b>	<b>10.4</b>	<b>1.5</b>	<b>9.9</b>	<b>9.9</b>	<b>-1.2</b>	<b>1.4</b>	<b>9.2</b>	<b>9.4</b>

Fishways are inspected twice daily. Overnight trend monitored via Old SCADA operating at west entrance.



Busted! Game camera evidence of Cormorants feeding on salmonids inside fishladder.