

The Dalles Dam Fishway Status Report

11/13/22

Inspection Period 11/06-11/12, 2022

THE DALLES DAM



US Army Corps
of Engineers
Portland District

The Dalles Project-Fisheries
P.O. Box 564
The Dalles, OR 97058-9998
Phone: 541-506-3800

The Dalles Dam	Inspections OOC	Criteria Limit	Total Number of Inspections: 14		Temperature: 54.7 °F
			Comments: W155 failure RCC restricted FB		Weekly Ave. Secchi: 5.3

NORTH FISHWAY

Exit differential	0	≤ 0.5'			
Count station differential	0	≤ 0.3'			
Weir crest depth	0	1.0' ± 0.1'			
Entrance weir N1	0	depth (≥ 8')	Average for the week	9.8	
Entrance Differential	0	1.0' - 2.0'	Average for the week	1.3	
N2	0	Closed			
PUD Intake differential	0	≤ 0.5'			

EAST FISHWAY

Exit differential	0	≤ 0.5'	Significant floating mats of weeds at east exit. Not effecting flows or fish passage.		
Removable weirs 154-157	0	Per forebay	Note; 155 weir hoist failed. Forebay restriction minimum 157' applied.		
Weir 158-159 differential	0	1.1' ± 0.1'			
Count station differential	0	≤ 0.3'	Less weed plugging at pickets.		
153 Weir crest depth	0	1.3' ± 0.1'			
Junction pool weir JP6	0	> 7.0'	Weekly average	11.0	
East entrance differential	0	1.0' - 2.0'	Weekly average	1.4	
Entrance weir E1	0	No criteria	Weekly average	8.4	
Entrance weir E2	0	depth (≥ 8')	Weekly average	10.8	
Entrance weir E3	0	depth (≥ 8')	Weekly average	10.8	
Collection channel velocity	0	1.5 - 4 fps	1.6 fps 11/3		
Transportation channel velocity	0	1.5 - 4 fps	4.3 fps 11/3		
North channel velocity	0	1.5 - 4 fps	3.32 fps 11/5		
South channel velocity	0	1.5 - 4 fps	4.47 fps 10/15		
West entrance differential	0	1.0' - 2.0'	Weekly average	1.3	
Entrance weir W1	0	depth (≥ 8')	Weekly average	10.1	
Entrance weir W2	0	depth (≥ 8')	Weekly average	10.3	
Entrance weir W3	0	No criteria	Weekly average	-2.1	
South entrance differential	0	1.0' - 2.0'	Weekly average	1.4	
Entrance weir S1	0	depth (≥ 8')	Weekly average	9.7	
Entrance weir S2	0	depth (≥ 8')	Weekly average	9.6	

JUVENILE BYPASS

Sluiceway operation	0	Units 1, 8, 18	MU 18 OOS, sluice gate 16-2 in operation		
Turbine trashrack drawdown	0	<1.5', biwklly	Monitoring FU drawdown due to weed buildup on intakes. Stable at .3' on all FUs		
Spill volume/pattern	0	1 to 22	NO SPILL.		
Turbine Unit Priority	0	per FPP			
Gatewells	0	Weekly	Nothing to report. All in Criteria 11/4/22		

Current Outages

MU19 & MU20 FOOS 10/07/2018 1205 – 10/27/2022 1700 T10 ACETYLENE

MU12 OOS 04/12/2021 0001 – 9/22/2023 ANNUAL

MU18 OOS 08/29/2022 0630-1/26/2023 1700, COOLER UPGRADES

MU22 11/14/2022 0630 – 12/08/2022 1700, FALL PROTECTION

MU17 OOS 11/07/2022 0630 – 12/01/2022 1700, TURBINE BRG

-MU5 FOOS 11/11/2022 0630 – 11/14/2022 1700, INVESTIGATE RELAY

Maintenance

Planning to revive old fish unit intake trashrack rake in anticipation for future debris concerns.

EFL exit weir 155 hoist failed in down position. Weir pull and repair mid December.

Permanent oil boom reinstallation planned for December 13 and 14.

Calibrations not accurate for W2, S2 and E1 fishway entrances. All entrances maintaining criteria.

Spillway assessment (MRER); Spillgates 1- 9 rehab 2034. Includes spillbay 9 trunnion pin repair. Spillway crane first priority

Planning spill gates 9 and 10 cable and gearbox swap. Replacing bulkhead seals needed for completing the work.

Fish unit rehab Phase 1A awaiting funding.

AWS intake trashrack debris management - PDT reviewing alternatives.

Planning repair of AWS trashrack lift beam for easier use if needed.

Predators

Planning removal of bass/walleye/catfish from all dewaterings for gut sample analysis. Aquiring WDFW permits.

Resident cormorants foraging around project, not at east ladder due to deterrents.

Northern Pikeminnow Management Program Columbia River Dam Angling & Site-Specific Fishery complete for the year

Research/Construction/Contractors

USGS river temperatures link [USGS ladder-river temperatures](#)

4 peaks counting 4/1-10/31. Video counting will occur through December this year.

Fish Accords Lamprey Passage plan ongoing at 90% due 09/01 DDR junction pool LPS. Investigating mods for entrance and exit weirs.

PTAGIS fishladder data collection at count stations continues

Lamprey translocation traps pulled 9/7 end of season

Zebra mussel sampling completed 8/15. No mussels detected on substrate in ladders.


Operations

Ice Trash sluiceway endgate open. Sluiceways 1,8,17 open.


East and North fishways in full service

Approved by: Ron Twiner, Operation Project Manager, The Dalles Dam

Avian Count at TDA, 11/6 to 11/12/2022

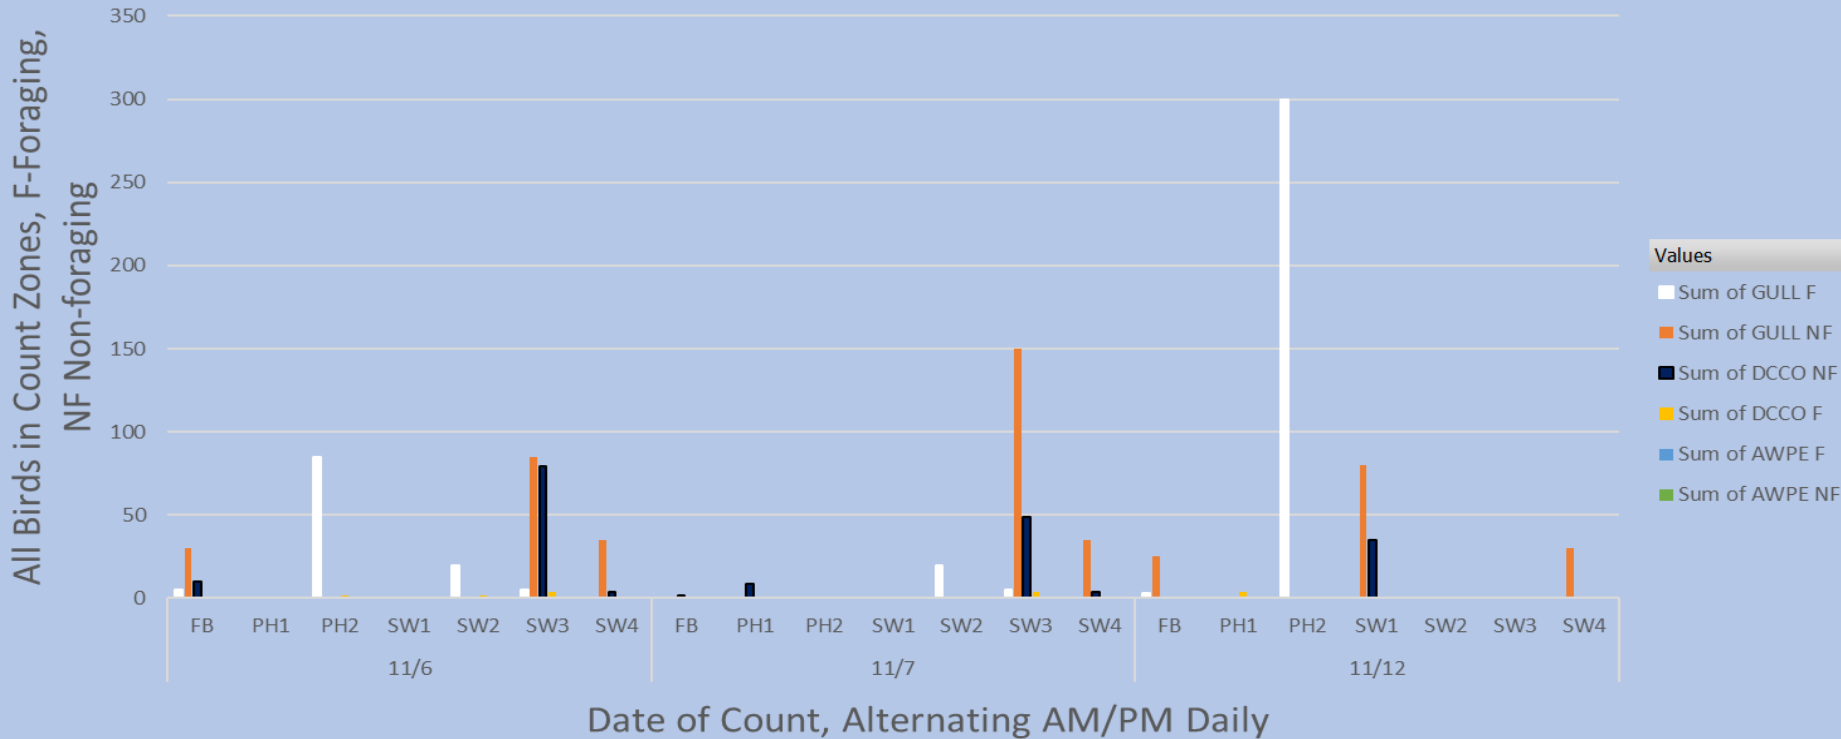

Adult Fish Ladders-River Temperatures

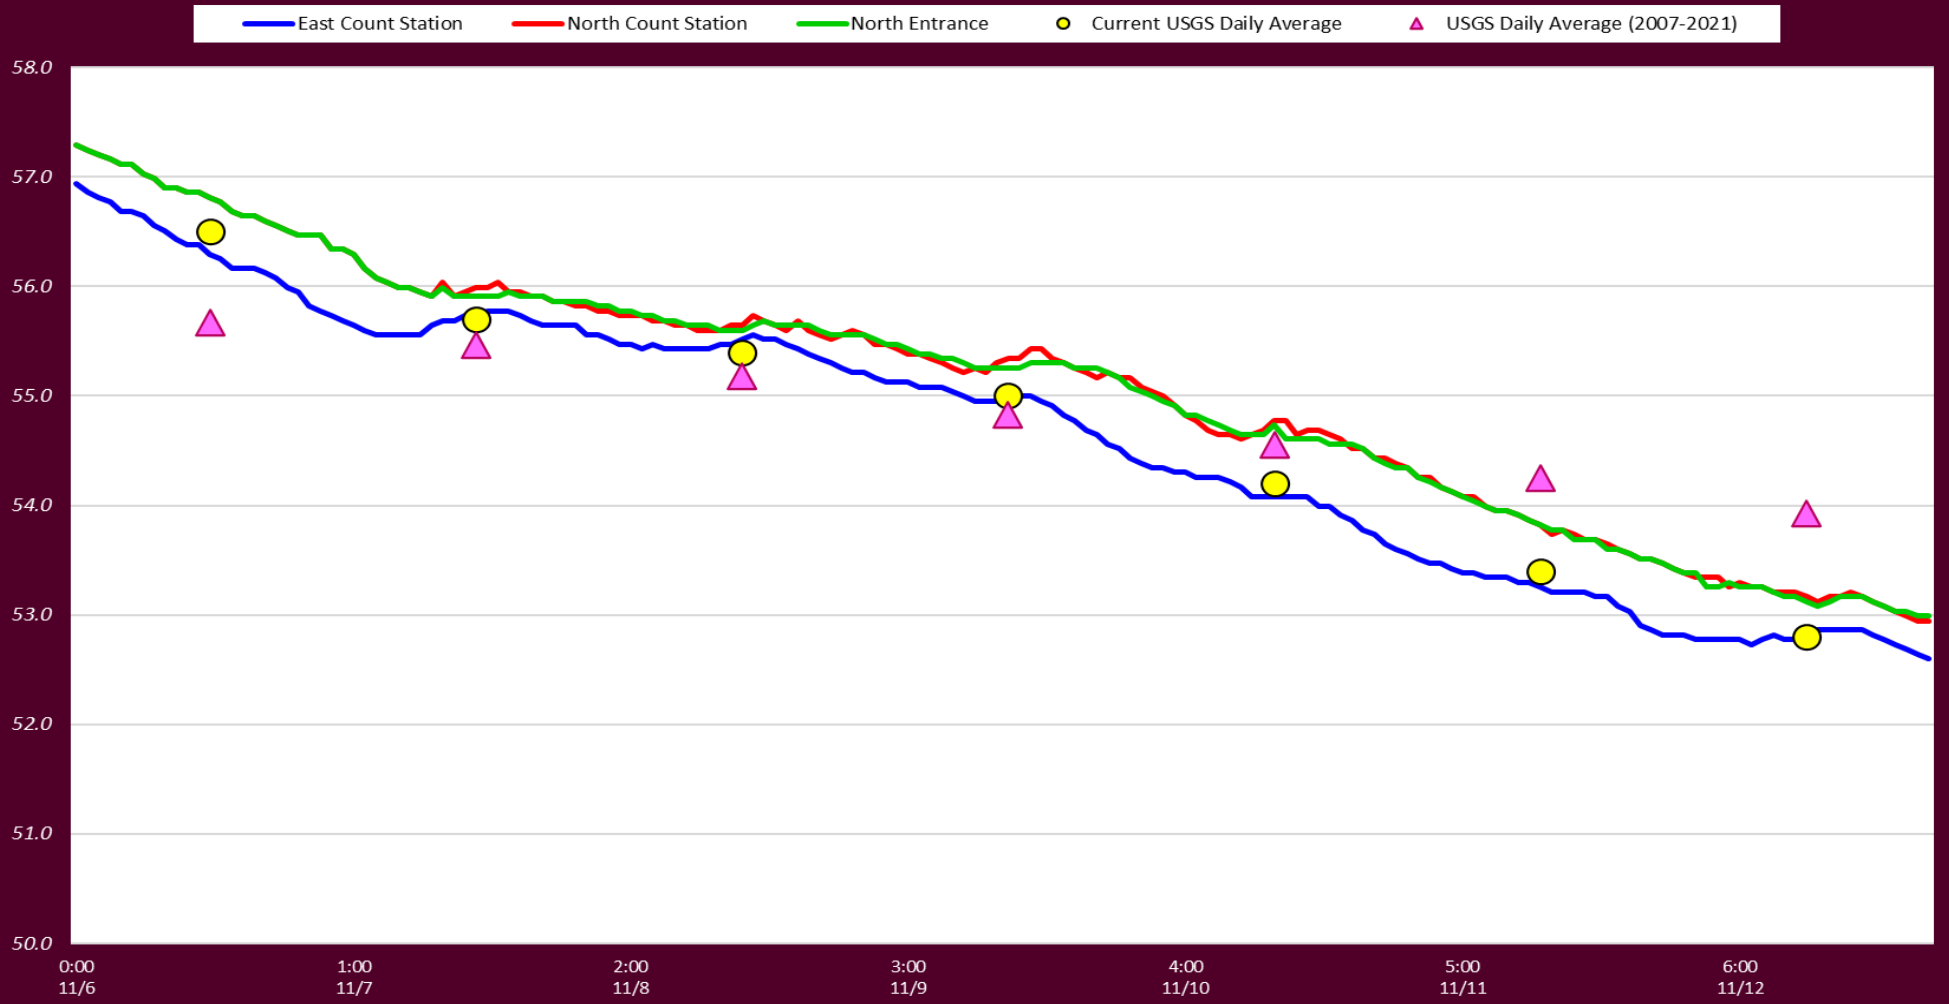

Secchi:		USGS°F
5.0	Sun	56.5
5.0	Mon	55.7
6.0	Tue	55.4
6.0	Wed	55.0
5.0	Thurs	54.2
5.0	Fri	53.4
5.0	Sat	52.8
5.29	AVG	54.7

Reporting week data

Date:	North Ladder		East Ladder											
			East Entrance					West Entrance			South Entrance			
	Differential	N1 Depth	Differential	E1 Depth	E2 Depth	E3 Depth	JP 6	Differential	W1	W2	W3	Differential	S1	S2
11/6	1.2	9.8	1.3	7.8	11.1	10.8	11.3	1.3	10.3	10.7	-2.3	1.5	8.2	9.1
	1.3	9.9	1.3	8.1	11.1	11.7	11.3	1.3	10.3	10.7	-2.2	1.4	9.8	9.6
11/7	1.2	9.8	1.3	7.3	10.6	11.8	9.8	1.3	9.7	10.1	-2.3	1.4	9.4	9.3
	1.1	9.8	1.5	6.8	11.4	11.3	11.1	1.3	9.5	9.9	-2.1	1.4	9.3	8.9
11/8	1.3	9.8	1.3	8.2	11.4	11.6	10.3	1.3	10.3	10.7	-1.8	1.4	10.1	9.9
	1.3	9.7	1.4	8.0	10.9	11.2	9.8	1.3	10.3	7.7	-1.7	1.4	10.2	9.8
11/9	1.4	9.7	1.4	8.8	11.3	10.8	11.8	1.2	10.7	11.2	-2.8	1.4	10.1	10.0
					10.9									
11/10	1.4	9.8	1.8	8.1	10.1	10.5	11.1	1.4	10.1	10.6	0.0	1.4	9.1	9.8
	1.3	9.9	1.6	9.0	10.3	10.7	11.1	1.4	10.0	10.4	-2.2	1.4	10.1	9.7
11/11	1.2	9.8	1.3	9.1	10.8	11.6	11.2	1.5	9.6	10.0	-2.9	1.5	9.4	9.3
	1.3	9.5	1.5	8.9	10.2	10.7	10.9	1.5	9.4	9.8	-2.7	1.5	9.5	8.4
11/12	1.4	9.7	1.4	9.3	10.3	10.8	11.3	1.2	10.4	10.9	-2.1	1.3	10.3	10.2
	1.4	9.8	1.4	9.4	10.3	10.9	11.4	1.3	10.4	10.9	-1.8	1.3	10.5	10.2
AVG:	1.3	9.8	1.4	8.4	10.8	11.1	11.0	1.3	10.1	10.3	-2.1	1.4	9.7	9.6

Fishways are inspected twice daily.

found out of criteria